


130 KL SUMP

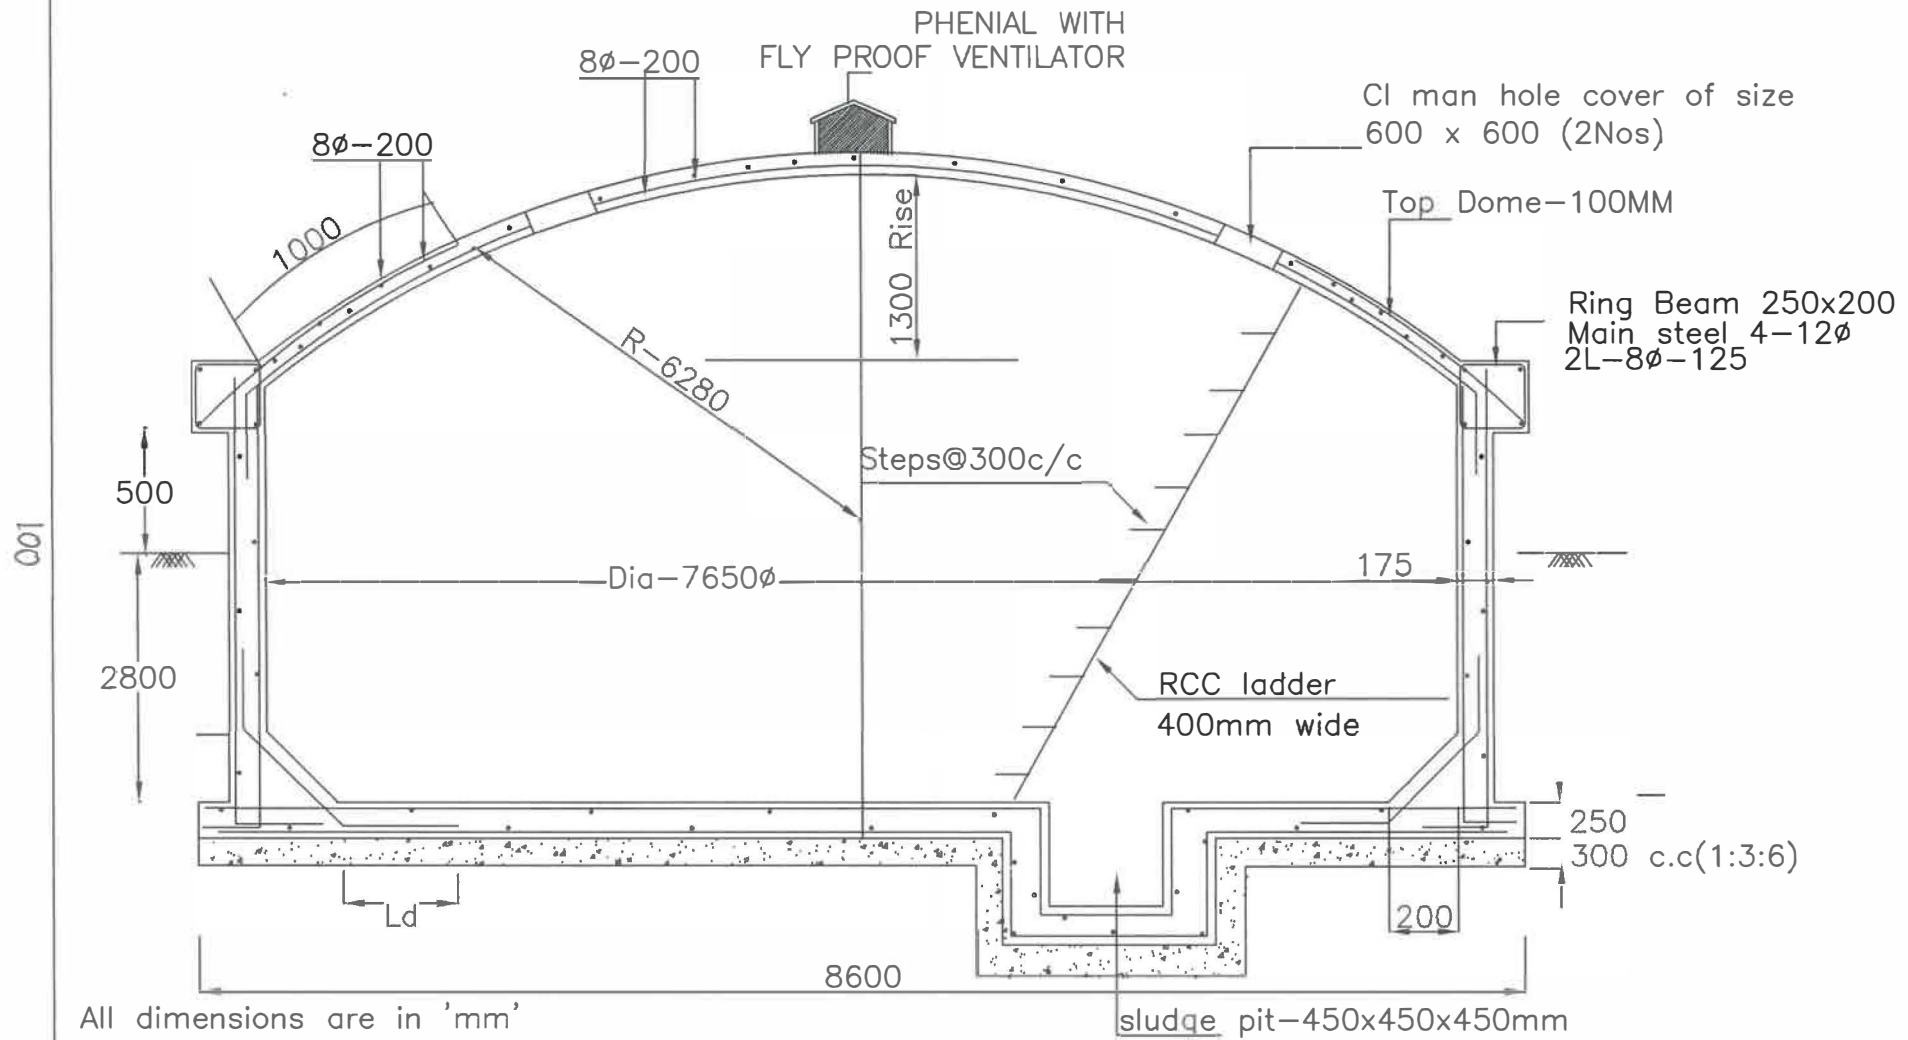

All dimensions are in 'mm'
Concrete mix V.R.C.C M30
Steel Fe-415
Reinforcement Details shall be as per IS - SP34

H.L. Sailaja
Asst Executive Engineer

P.R.
Dy. Executive Engineer

Y.S.
Executive Engineer


//Approved//

Chief Engineer -
RWS&S, Gollapudi
Vijayawada.

SCHEME:

DWG.NO.1

130 KL SUMP

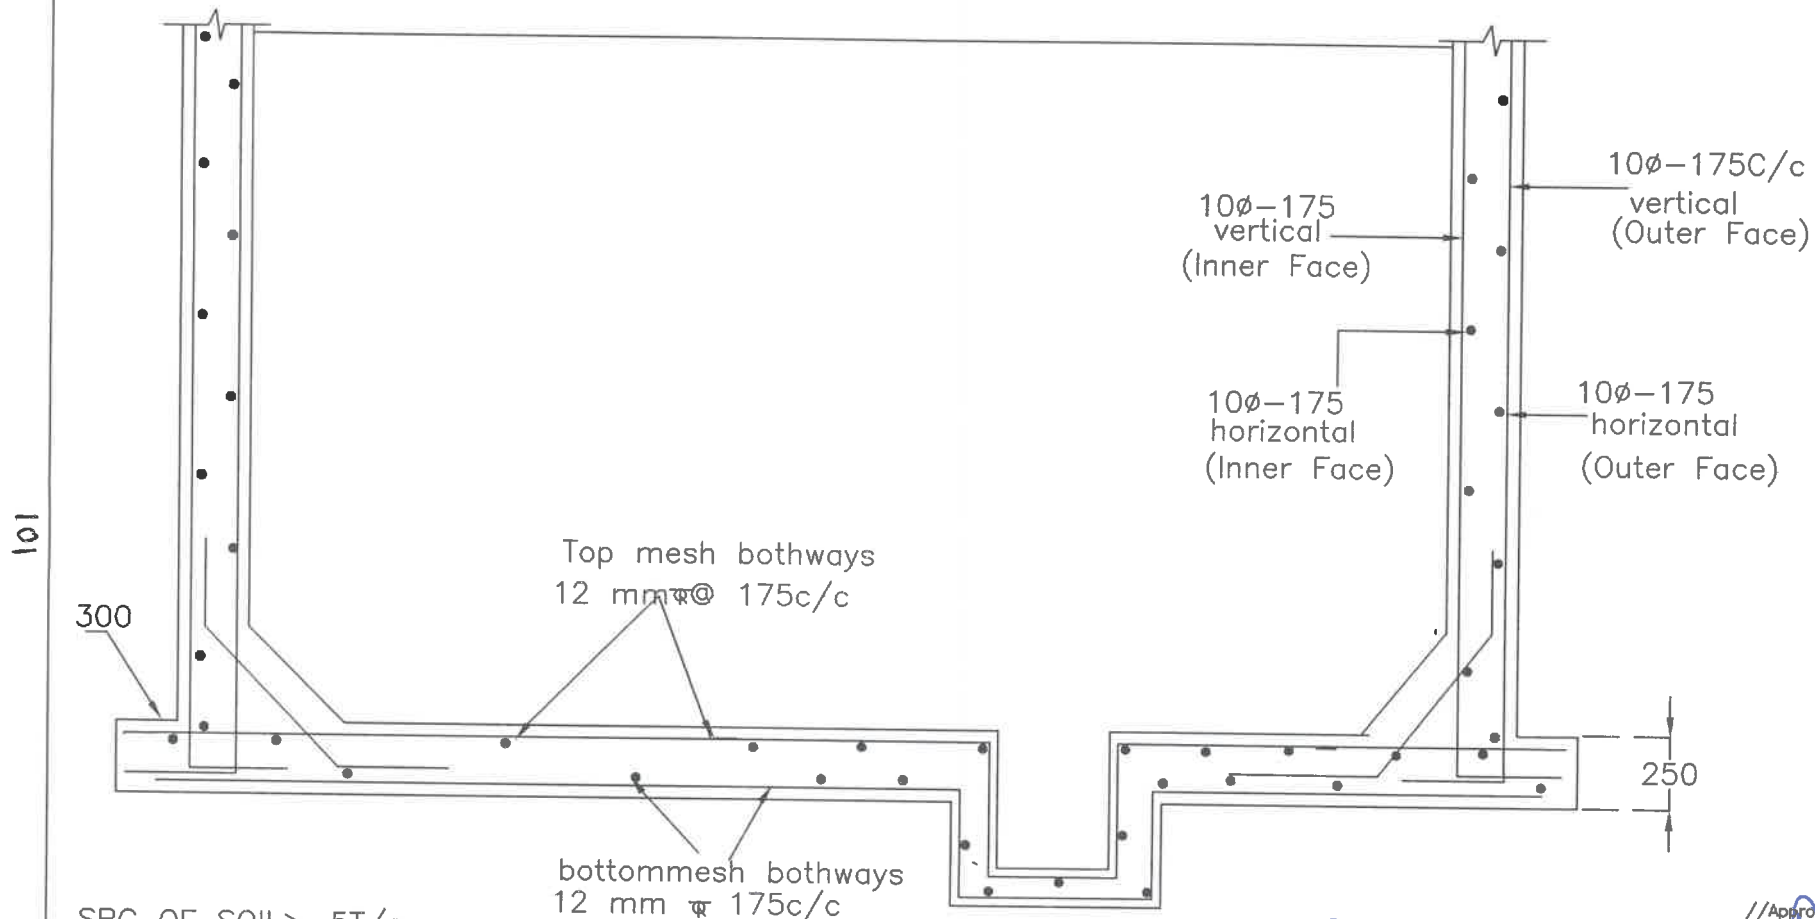

SBC OF SOIL $\geq 5T/sqm$

Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table $< 1.75m$ below GL

H. L. Sathya
Asst Executive Engineer

P. R.
Dy. Executive Engineer


Y. S.
Executive Engineer

//Approved//
P. S. S.
Chief Engineer II
RWS&S, Gollapudi
Vijayawada.


SCHEME:

DWG.NO.2

130 KL SUMP

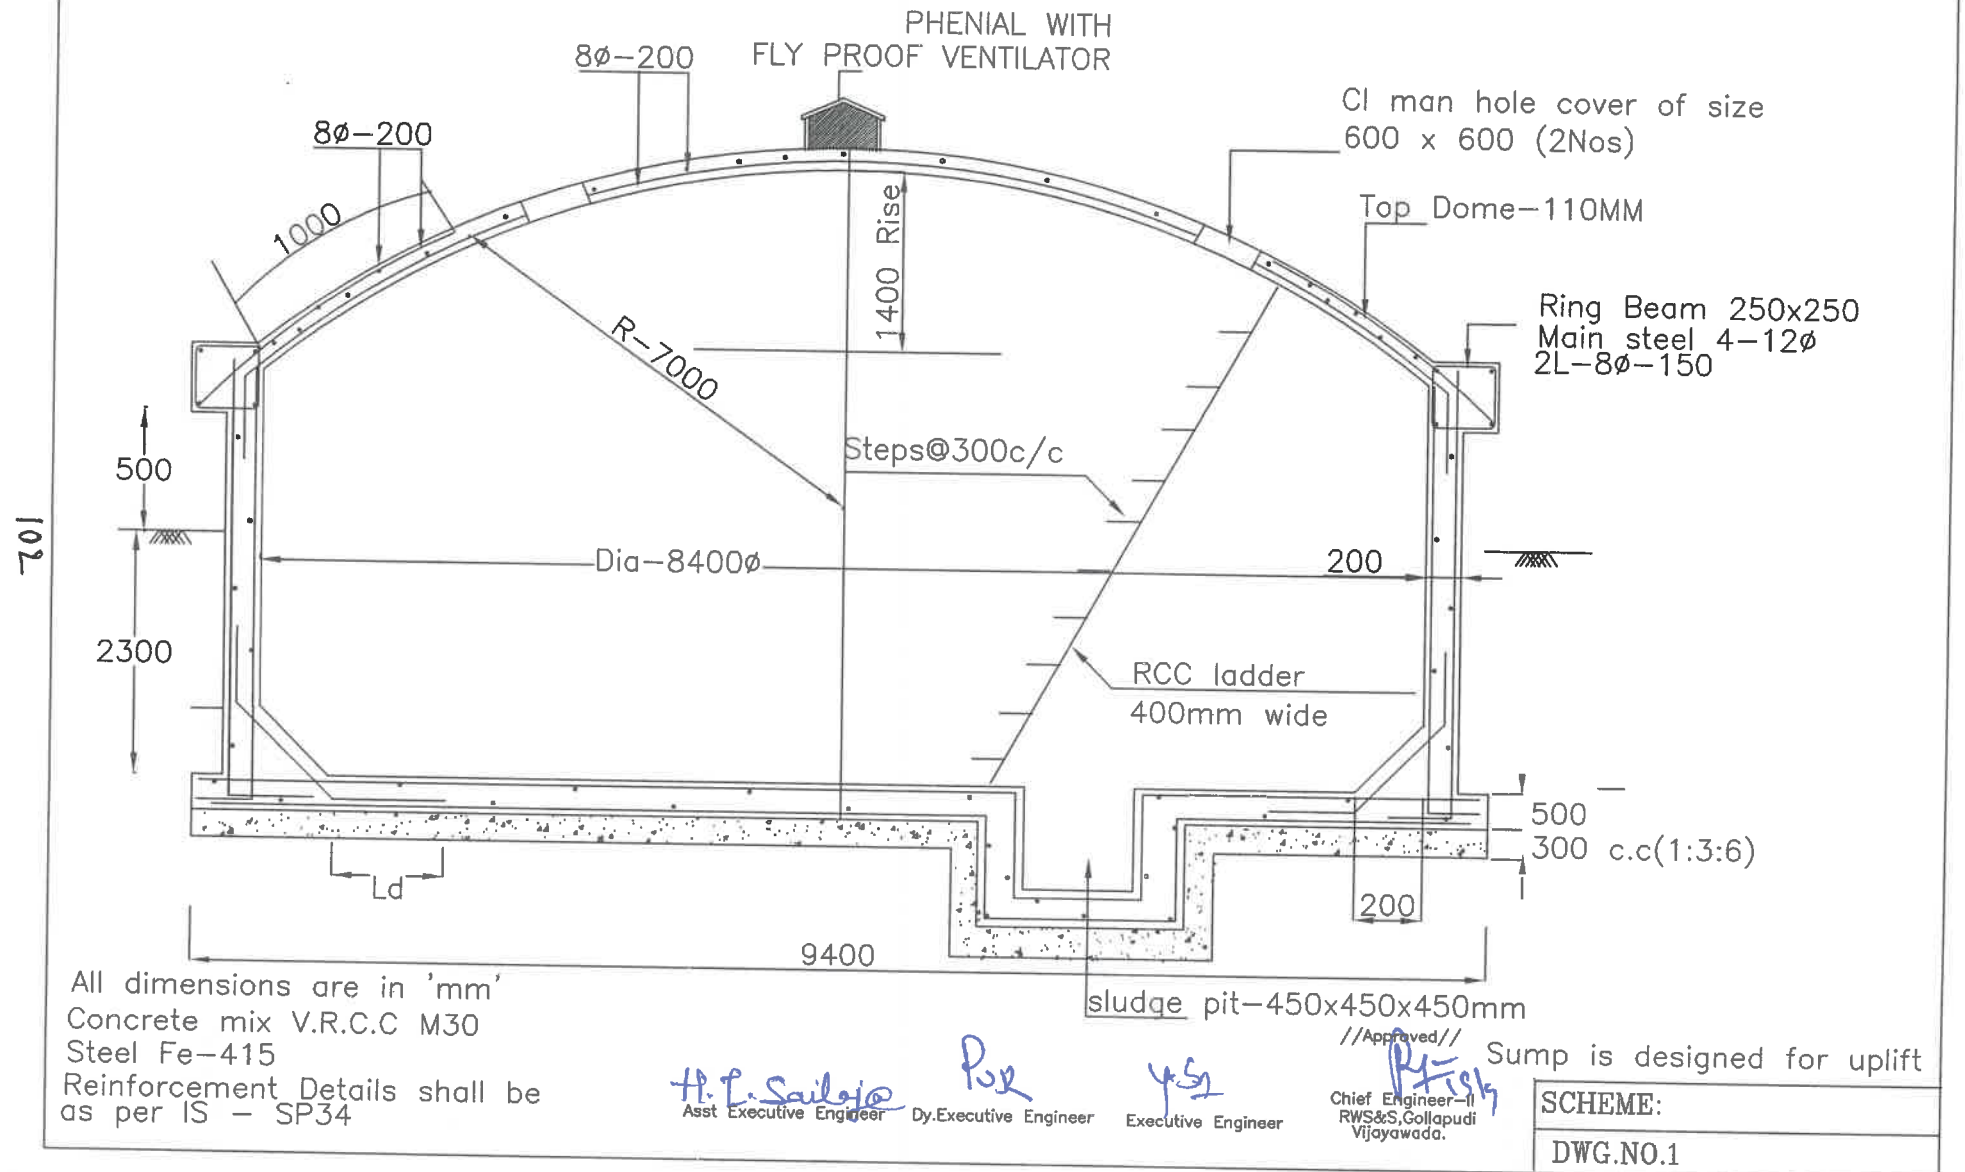

130 KL SUMP

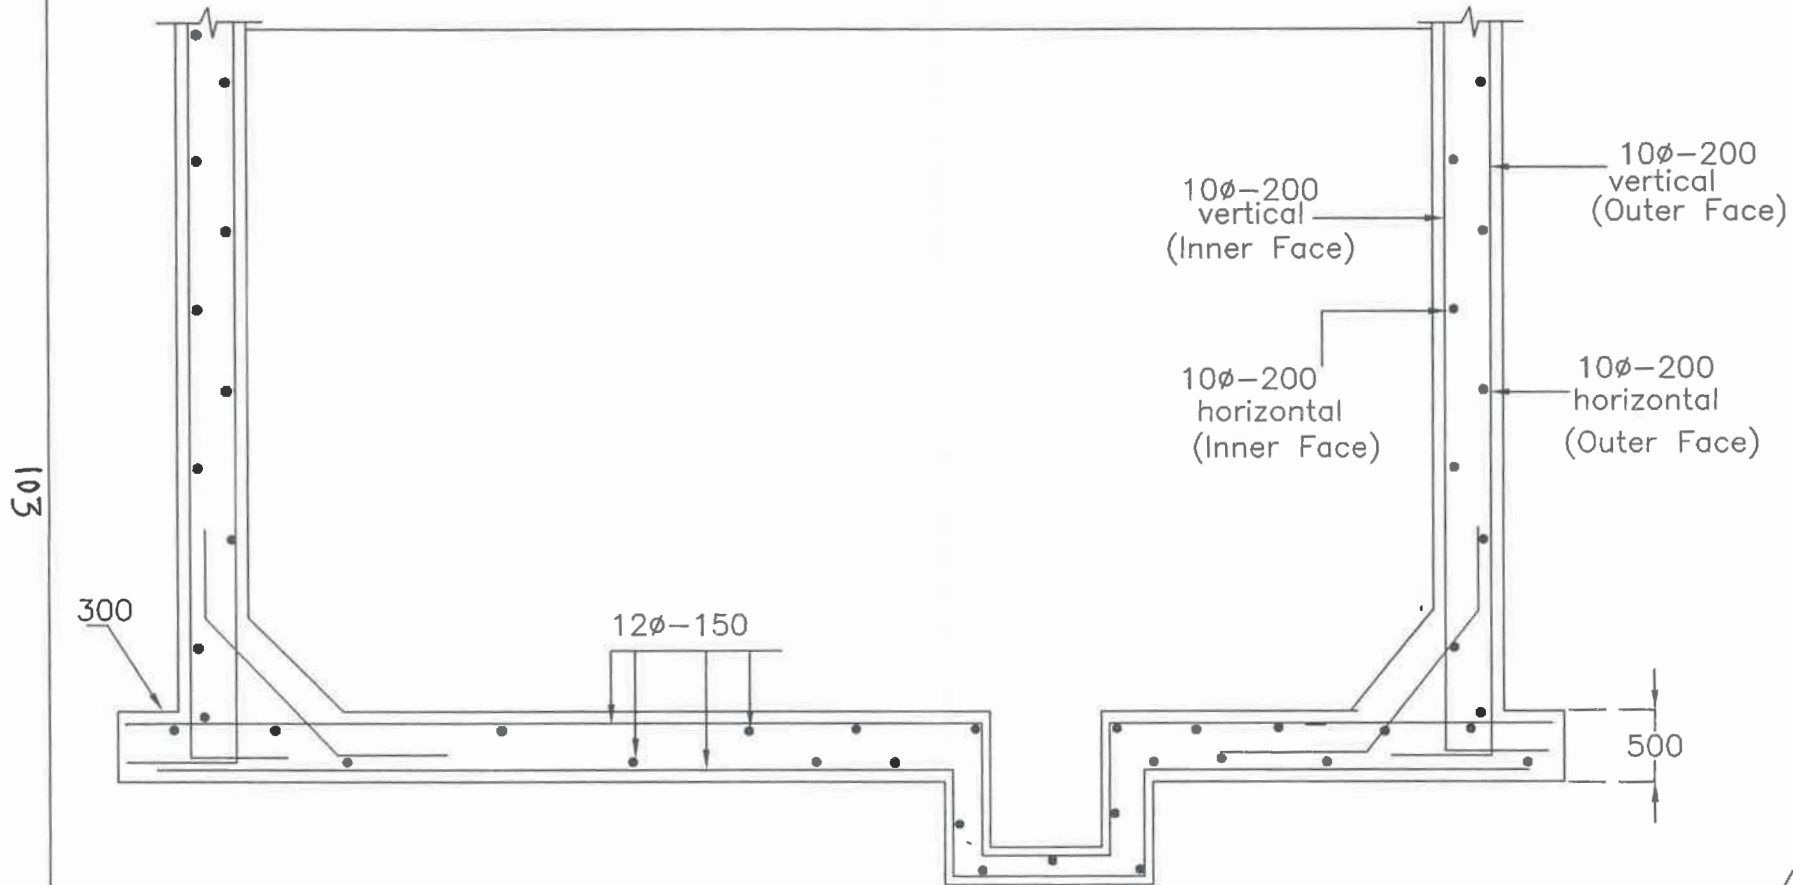

SBC OF SOIL $\geq 5T/sqm$

Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table $< 1.0m$ below GL

H. P. Sailesh Asst. Executive Engineer

P. K. Dy. Executive Engineer

Y. S. Executive Engineer

// Approved //
P. K. Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.

SCHEME:

DWG.NO.2