


20KL Sump

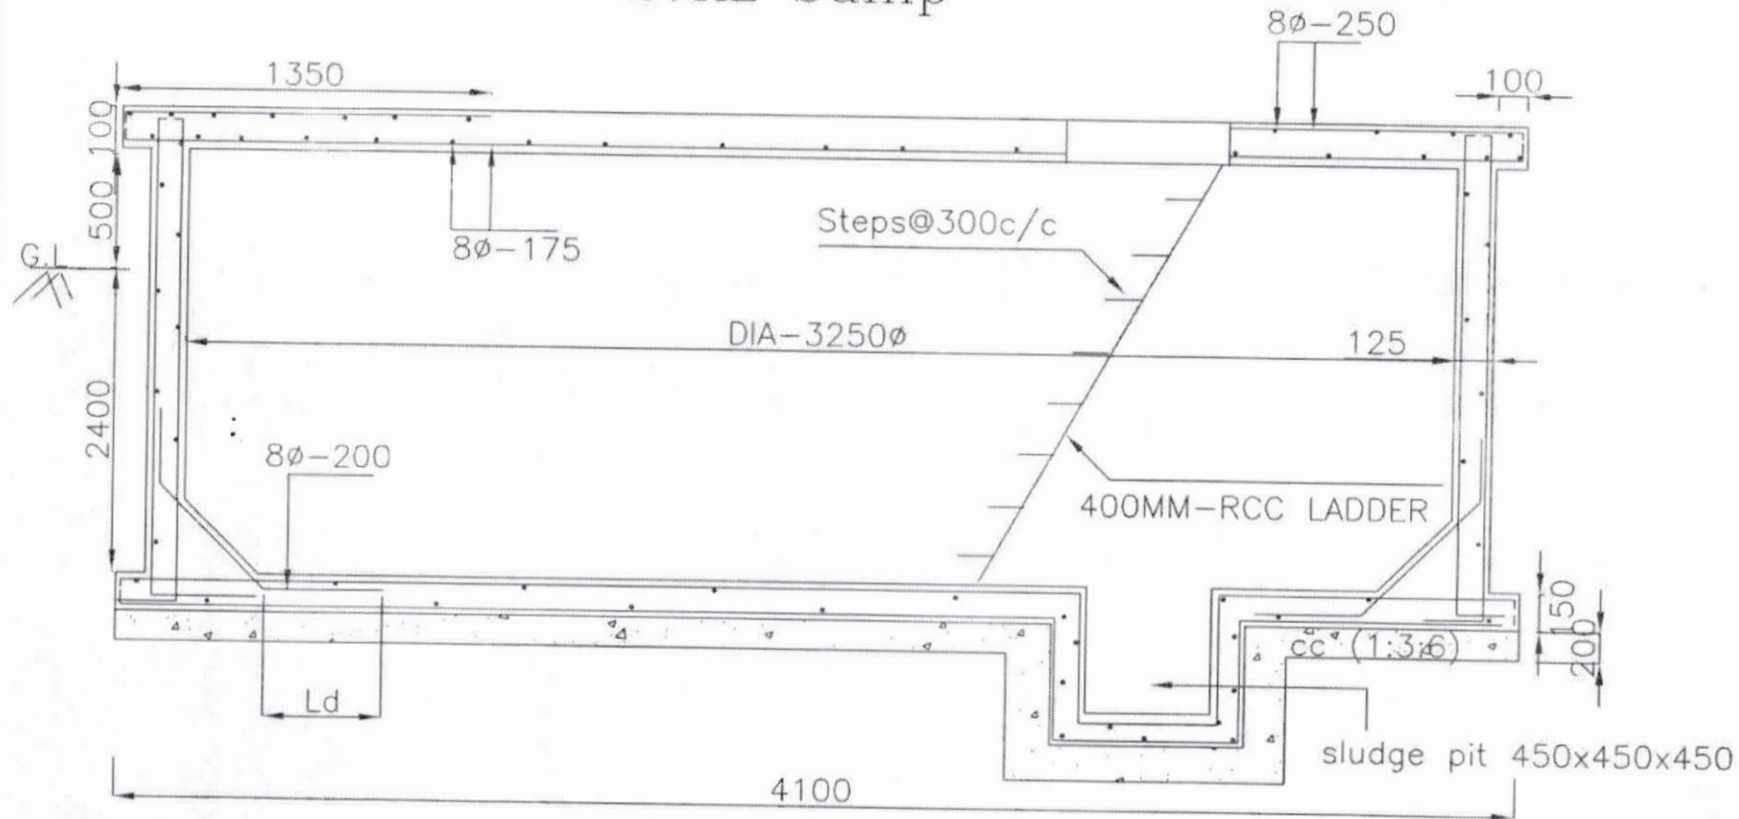

All dimensions are in 'mm'
Concrete mix V.R.C.C M30
Steel Fe-415
Reinforcement Details shall be
as per IS - SP34

SBC OF SOIL $\geq 5.0T/sqm$
Depth of water table is -1.0m below GL

Asst Executive Engineer

Dy.Executive Engineer

// Approved //


Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.

Note: provide sand bed as per site conditions
and verify the uplift condition before grounding
the work, if depth of water table < 1.0m below GL

SCHEME:

DWG.NO.1

20KL Sump

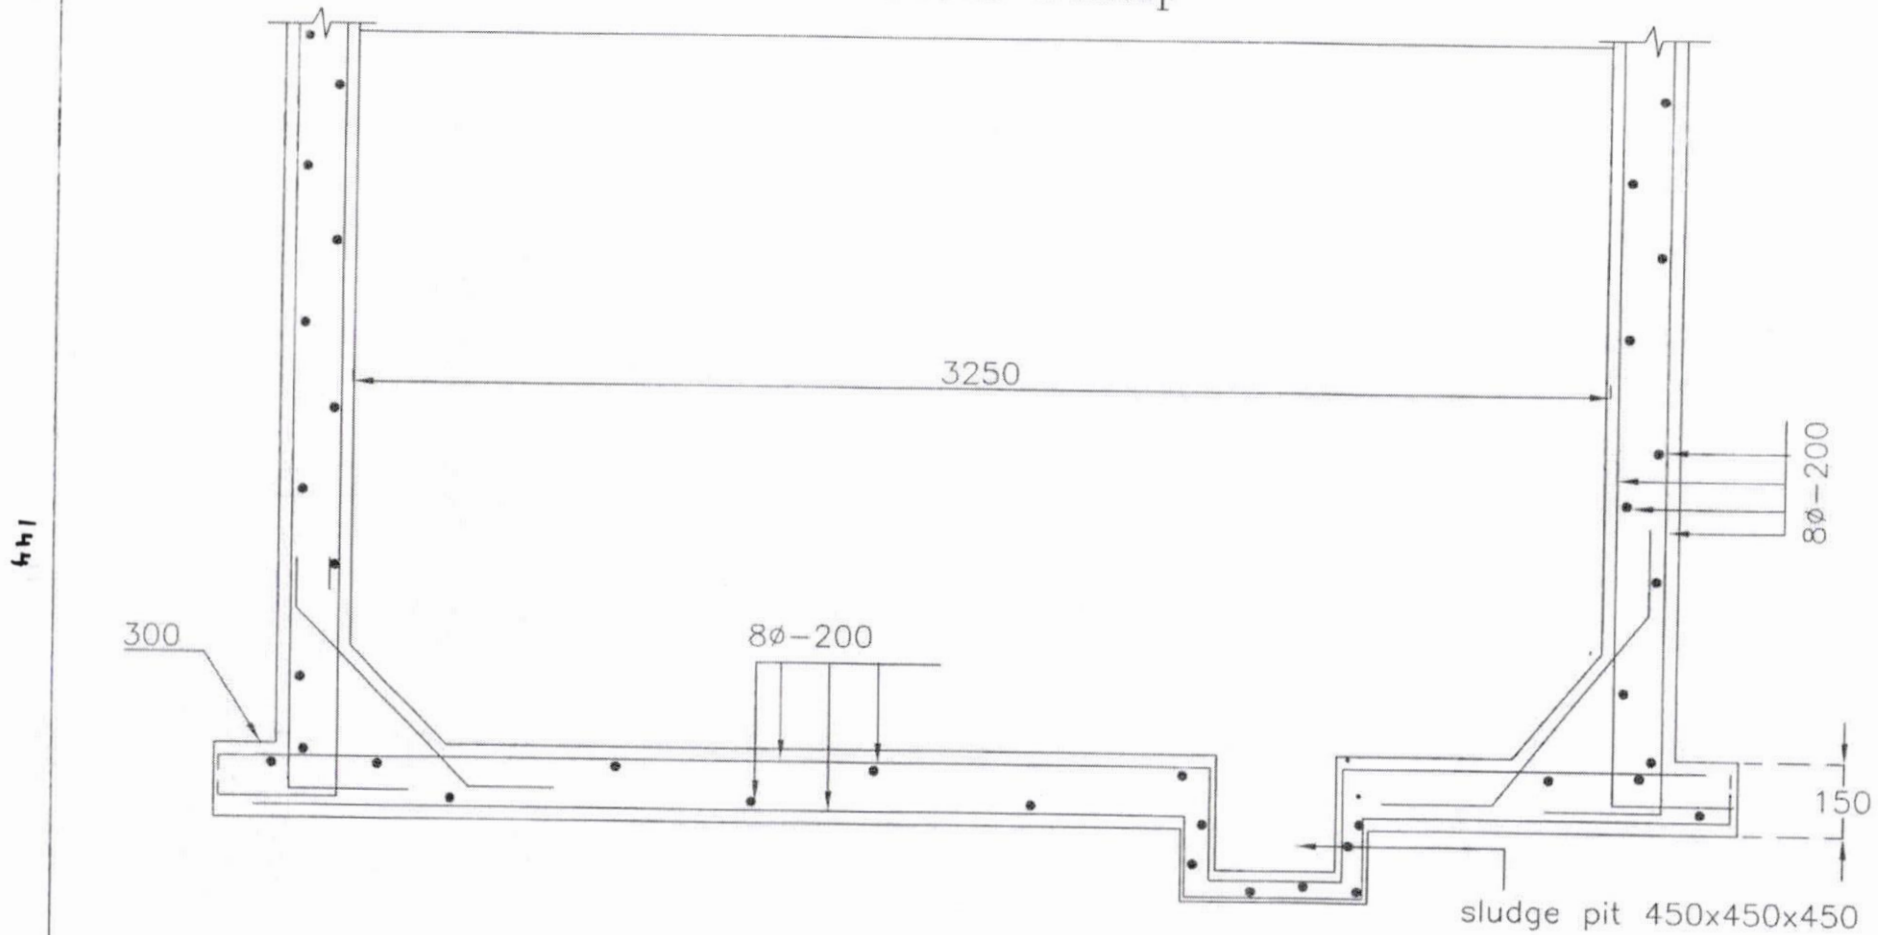

BR
Asst Executive Engineer Dy.Executive Engineer
25.1.19

//Approved//
Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.

SCHEME:

DWG.NO.2