




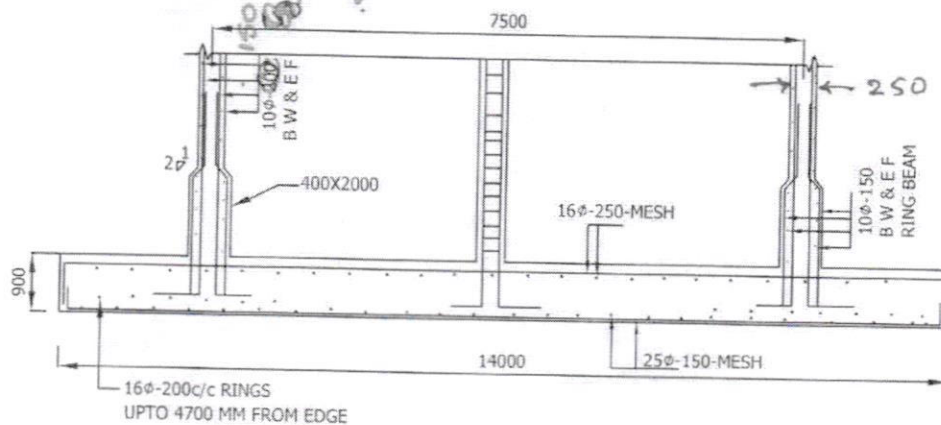

SECTIONAL ELEVATION

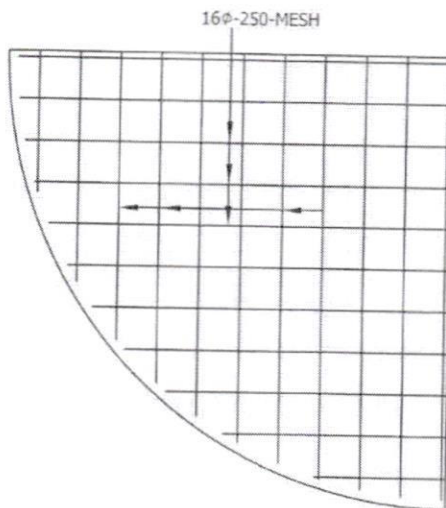

TOP REINFORCEMENT

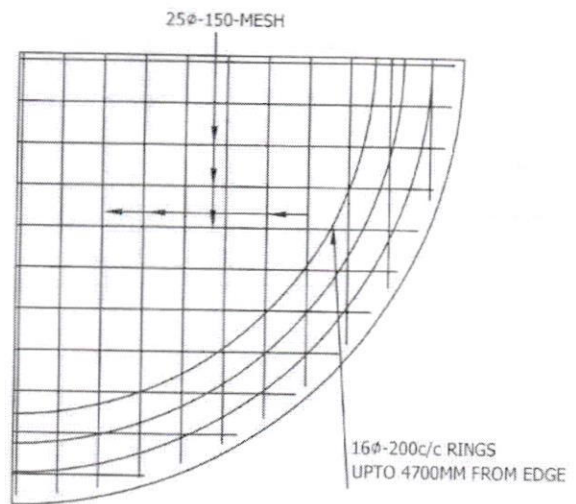

BOTTOM REINFORCEMENT

NOTE:

- 1.GRADE OF CONCRETE : M30
- 2.GRADE OF STEEL : Fe415
3. BASIC WIND SPEED : 200KMPH
- 4.DEPTH OF FOUNDATION:2.50m BELOW GROUND LEVEL UPTO TOP OF RAFT
- 5.ALL DIMENSIONS ARE IN "MM"
6. S B C OF SOILL-10 T/SQM

R.R.
Asst. Executive Engineer


15.2.2019
Dy. Executive Engineer

/Approved/
Chief Engineer-II
K.V.S.S. Gollapudi
Vijayawada.


SCHEME:

250 K.L OHBR 30.00M STG.


DRGNO:3

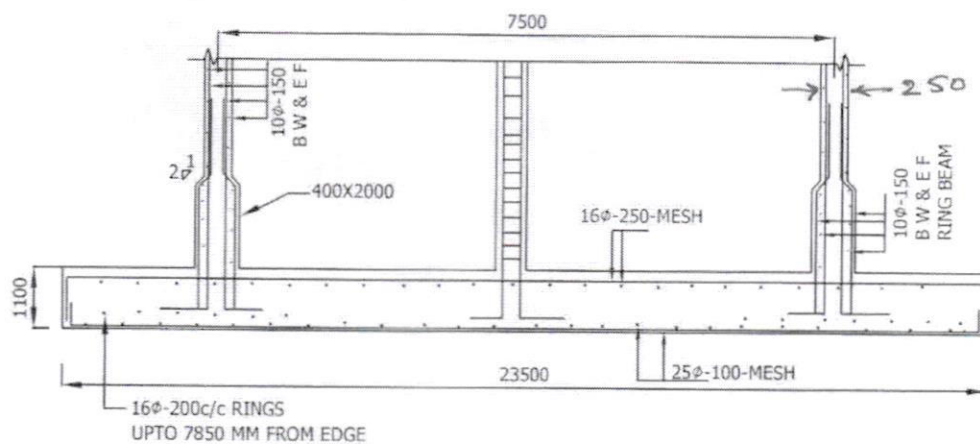

SECTIONAL ELEVATION

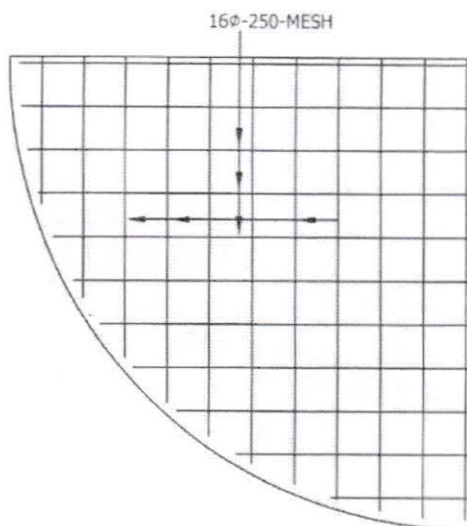

TOP REINFORCEMENT

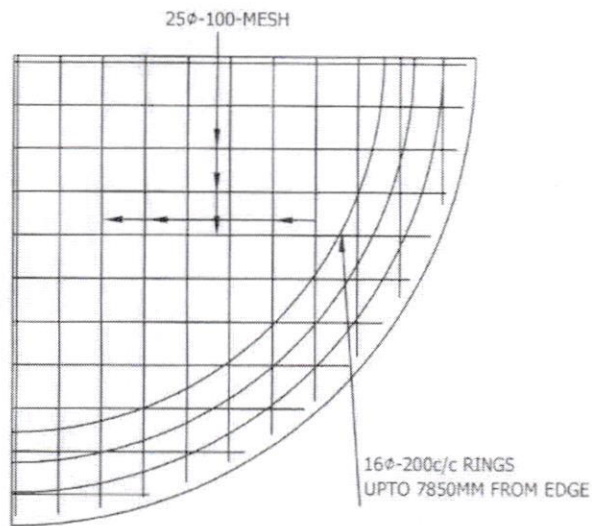

BOTTOM REINFORCEMENT

NOTE:

- 1.GRADE OF CONCRETE : M30
- 2.GRADE OF STEEL : Fe415
3. BASIC WIND SPEED : 200KMPH.
- 4.DEPTH OF FOUNDATION:2.50m BELOW GROUND LEVEL UPTO TOP OF RAFT
- 5.ALL DIMENSIONS ARE IN "MM"
6. S B C OF SOILL-5 T/SQM

Por
Asst. Engr. Srinivas

15.2.19
Executive Engineer


Dy. Executive Engineer

Approved//
Engr. Engineer-II
RWS&S, Gollapudi
Vijayawada.

SCHEME:

250 K.L OHBR 30.00M STG.

DRGNO:3

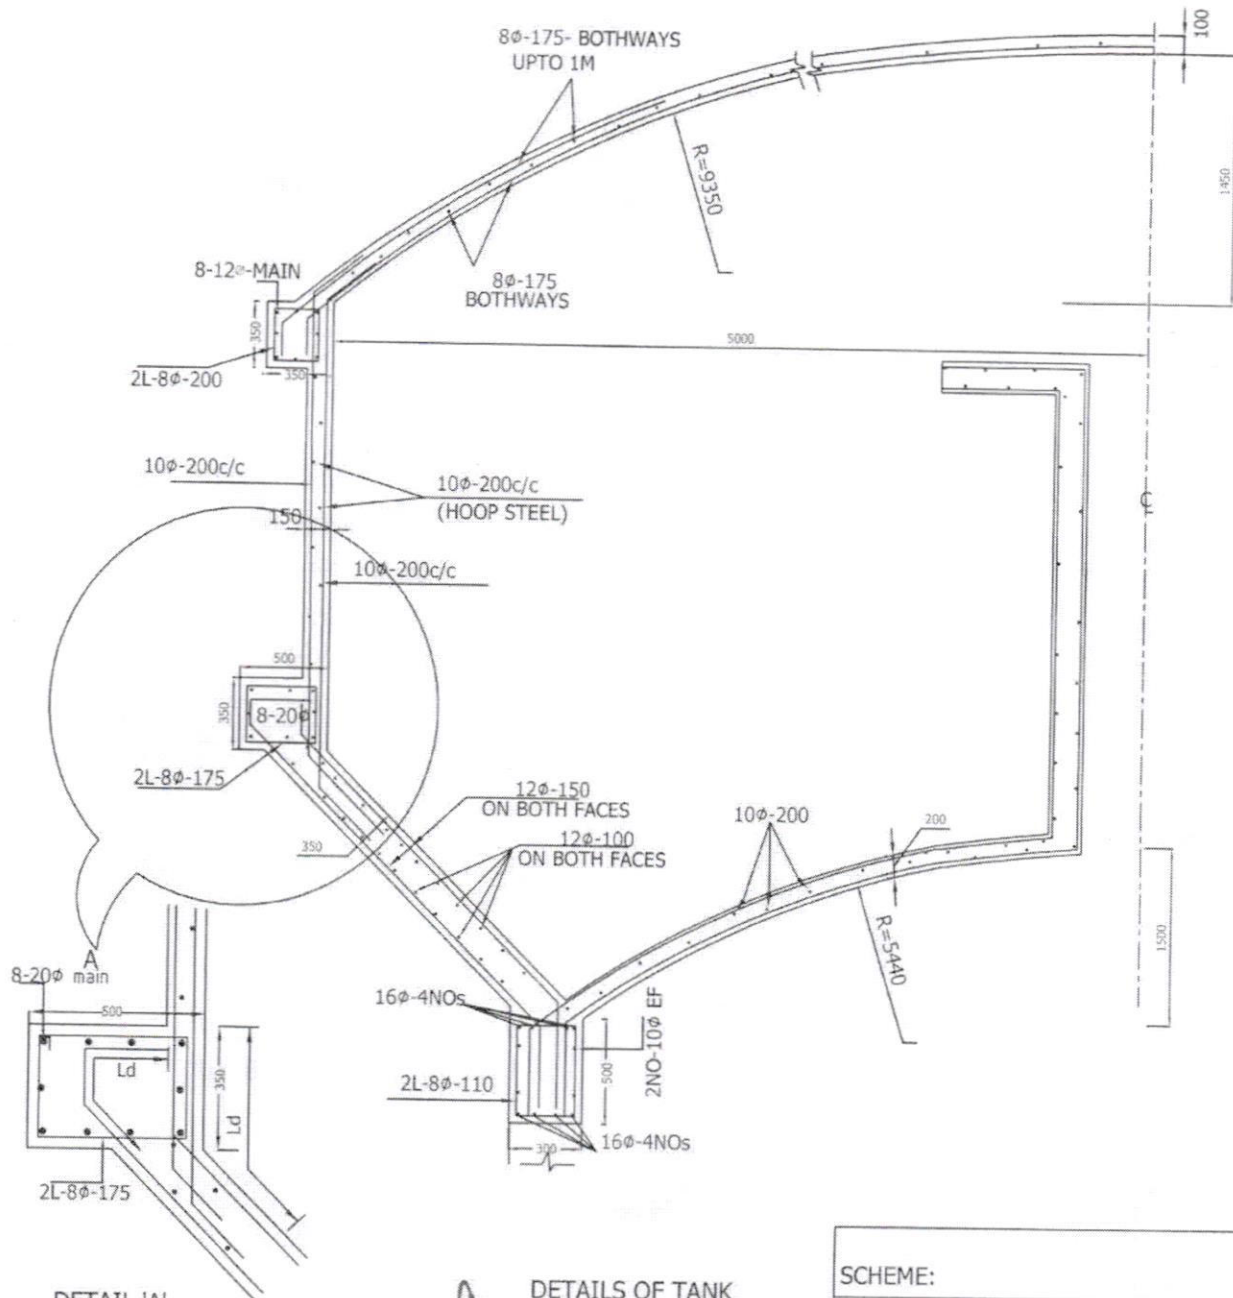

DETAIL 'A'

Pur
Asst. Executive Engineer

[Signature]
Dy. Executive Engineer



[Signature]
Checked by: II
RWSES, Gollapudi
Vijayawada.

DETAILS OF TANK

SCHEME:

250KL-OHBR-STAGING: 30.00M

DRGNO:2

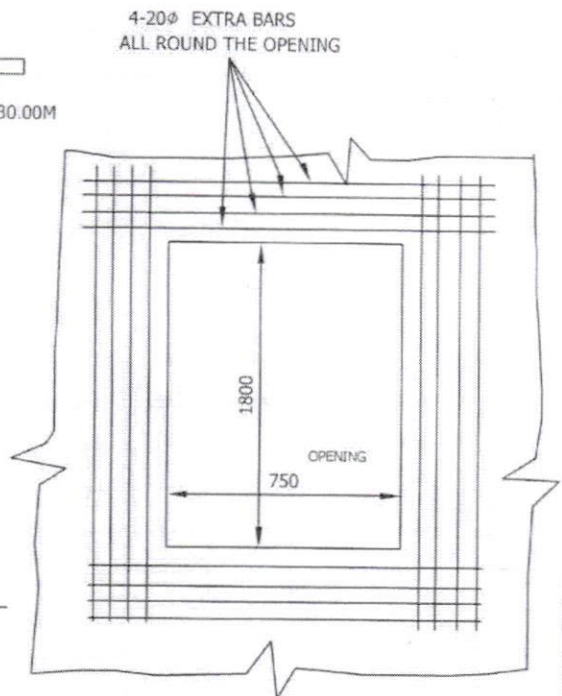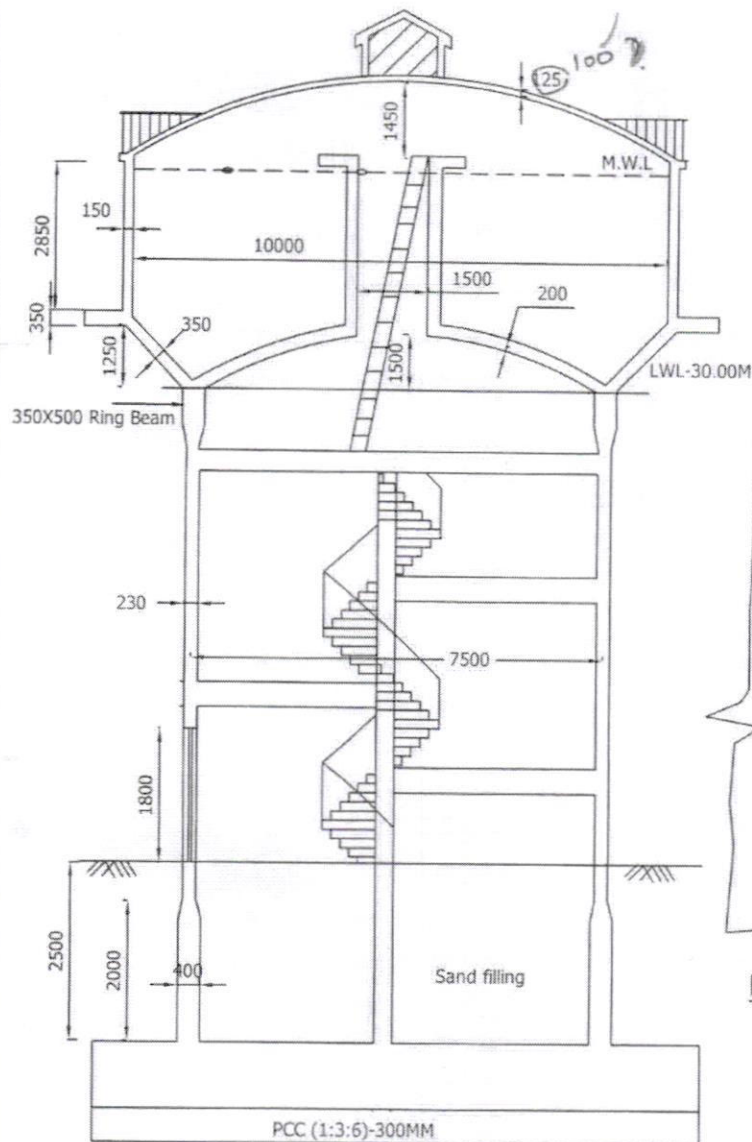


DETAILS AT THE OPENING OF SHAFT

Ra
Asst Executive Engineer


Ra
15.2.2019
Dy. Executive Engineer

//Approved//
[Signature]
Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.


SCHEME:
250 K.L OHBR 30.00M STG.
DRGNO:1

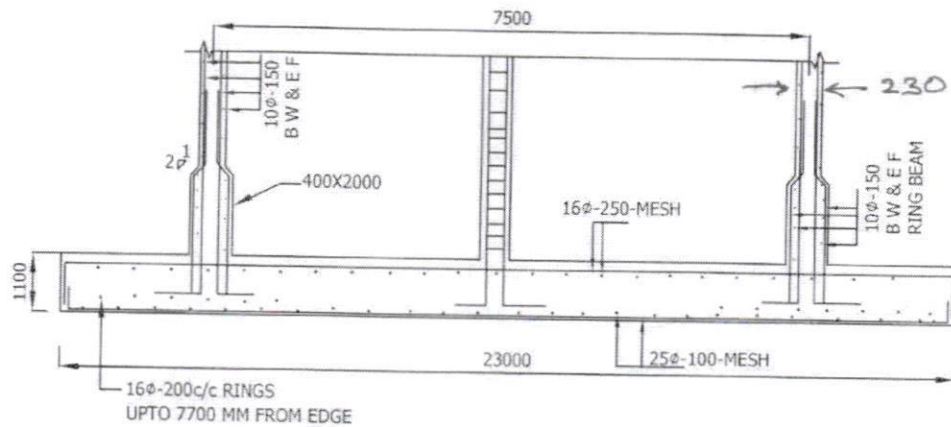

SECTIONAL ELEVATION

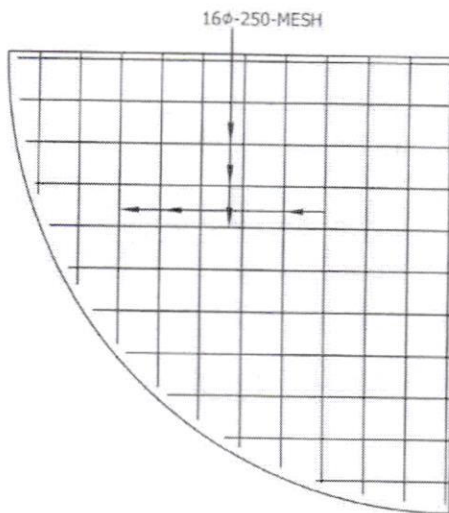

TOP REINFORCEMENT

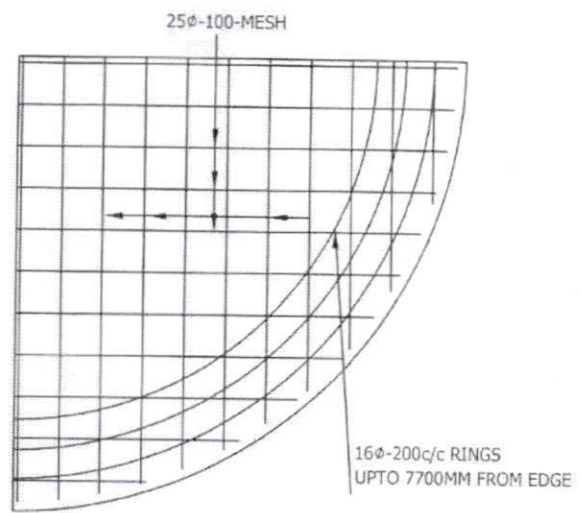

BOTTOM REINFORCEMENT

NOTE:


- 1.GRADE OF CONCRETE : M30
- 2.GRADE OF STEEL : Fe415
3. BASIC WIND SPEED : 150KMPH
- 4.DEPTH OF FOUNDATION:2.50m BELOW GROUND
LEVEL UPTO TOP OF RAFT
- 5.ALL DIMENSIONS ARE IN "MM"
6. S B C OF SOILL-5 T/SQM

RGR
Asst Executive Engineer


90M
15.2.2019
Dy.Executive Engineer

Approved
Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.


SCHEME:
250 K.L OHBR 30.00M STG.
DRGNO:3

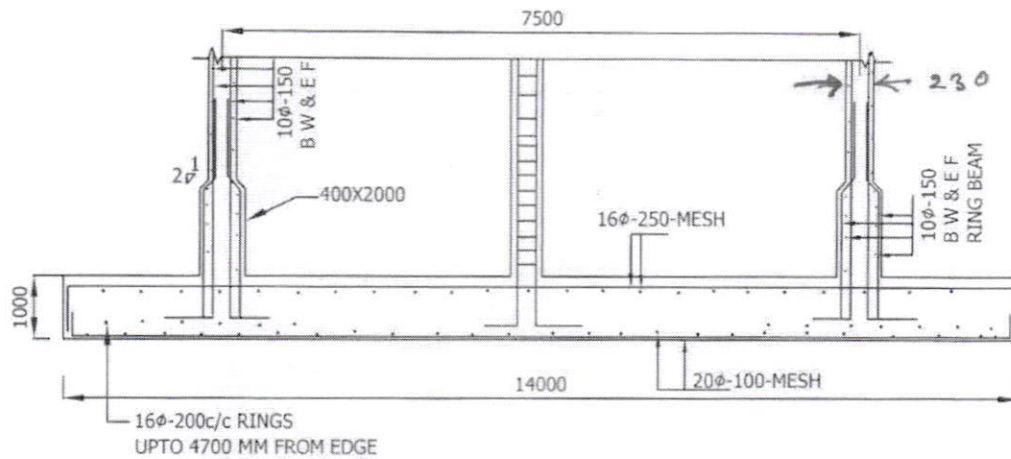

SECTIONAL ELEVATION

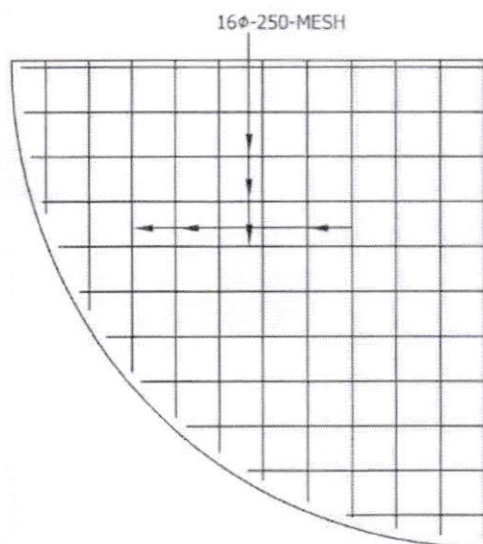

TOP REINFORCEMENT

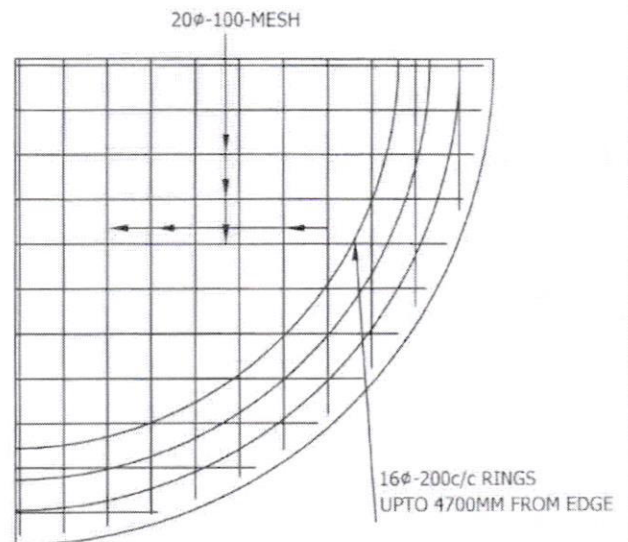

BOTTOM REINFORCEMENT

NOTE:

- 1.GRADE OF CONCRETE : M30
- 2.GRADE OF STEEL : Fe415
3. BASIC WIND SPEED : 150KMPH
- 4.DEPTH OF FOUNDATION:2.50m BELOW GROUND LEVEL UPTO TOP OF RAFT
- 5.ALL DIMENSIONS ARE IN "MM"
6. S B C OF SOILL-10 T/SQM

Asst Executive Engineer

Dy.Executive Engineer

// Approved //

Chinmay Engineer-II
RWS&S,Gollapudi
Vijayawada.

SCHEME:

250 K.L OHBR 30.00M STG.

DRGNO:3