




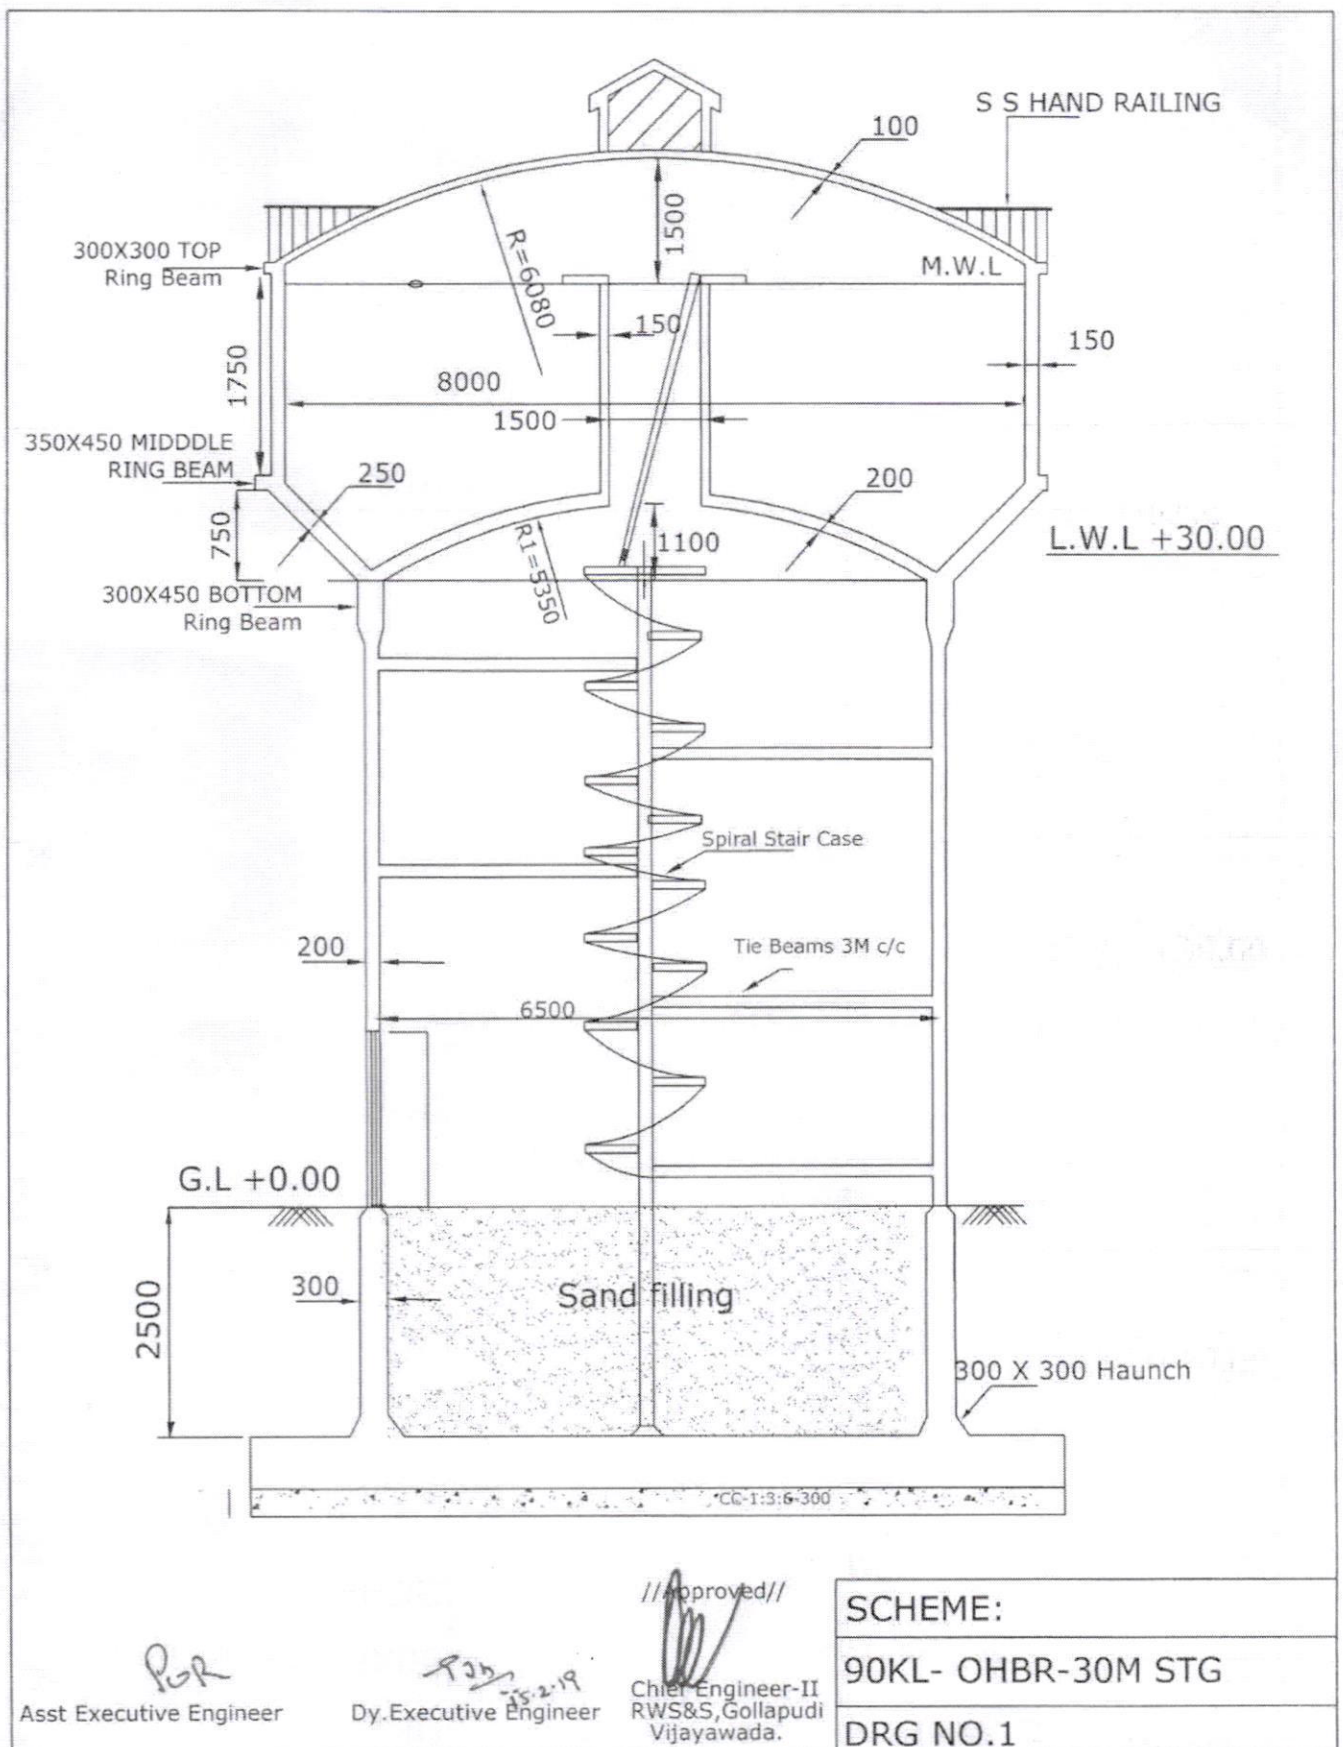

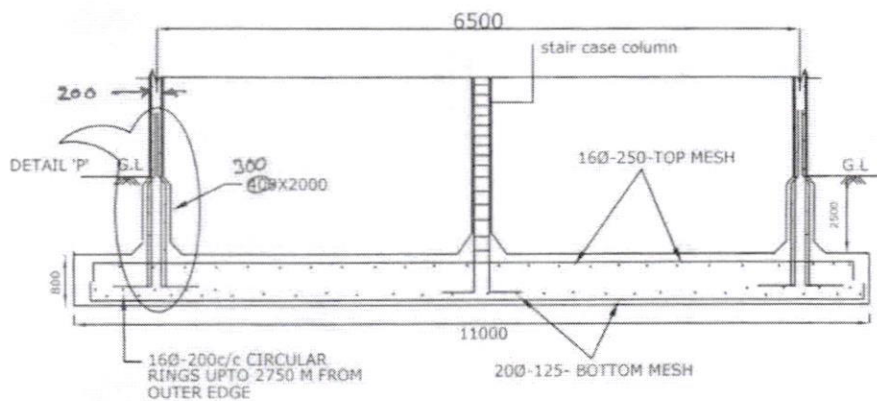


SECTIONAL ELEVATION OF RAFT

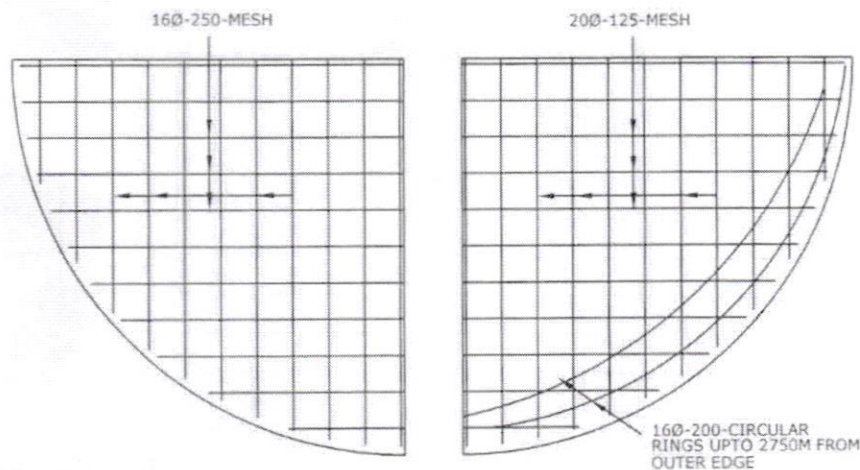

TOP REINFORCEMENT

BOTTOM REINFORCEMENT

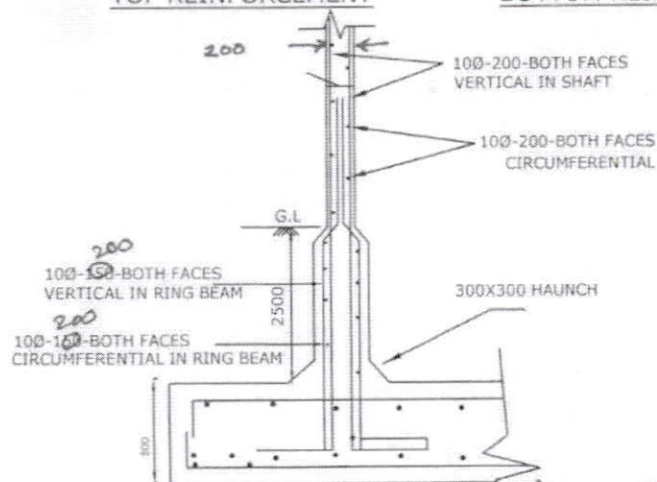

NOTE:

1. GRADE OF CONCRETE : M30
2. GRADE OF STEEL : Fe415
3. BASIC WIND SPEED : 150 KMPH
4. S.B.C. OF SOIL : 10.0 t/m²
5. DEPTH OF FOUNDATION : 2.5m BELOW GL UPTO TOP OF RAFT
6. FOR DETAILING OF REINFORCEMENT IS SP-34 SHALL BE FOLLOWED
7. PROVISIONS GIVEN IN IS 456-2000, IS 3370(PART-IV) SHALL BE FOLLOWED

// Approved //

Asst Executive Engineer


DETAIL 'P'
Dy. Executive Engineer

Engineer-II
RWS&S, Gollapudi
Vijayawada.


SCHEME:

90KL- OHBR-30M STG

DRG NO.3

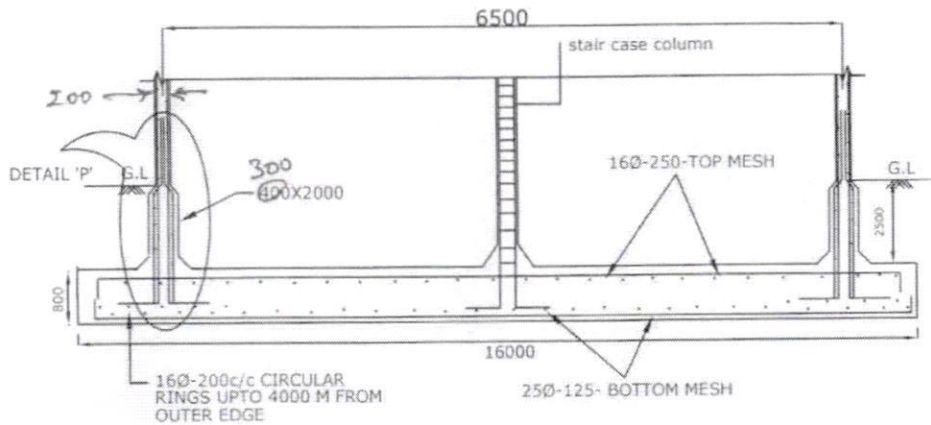


SECTIONAL ELEVATION OF RAFT

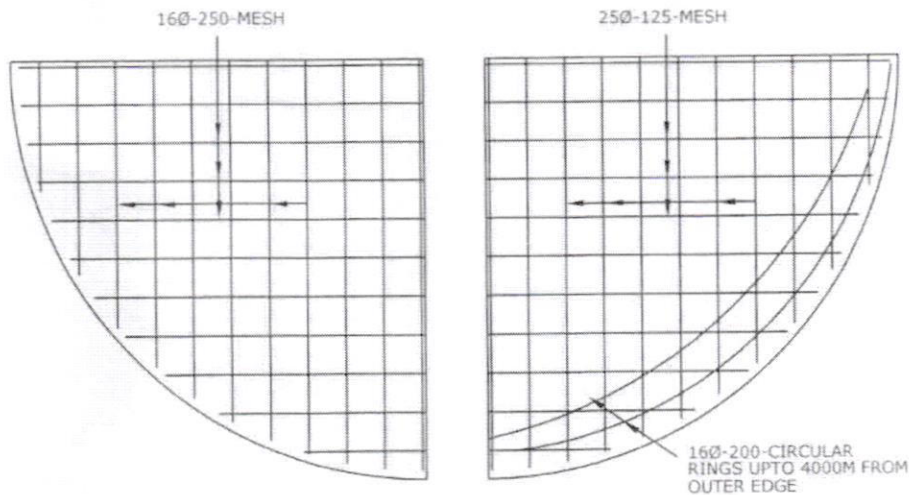

TOP REINFORCEMENT

BOTTOM REINFORCEMENT

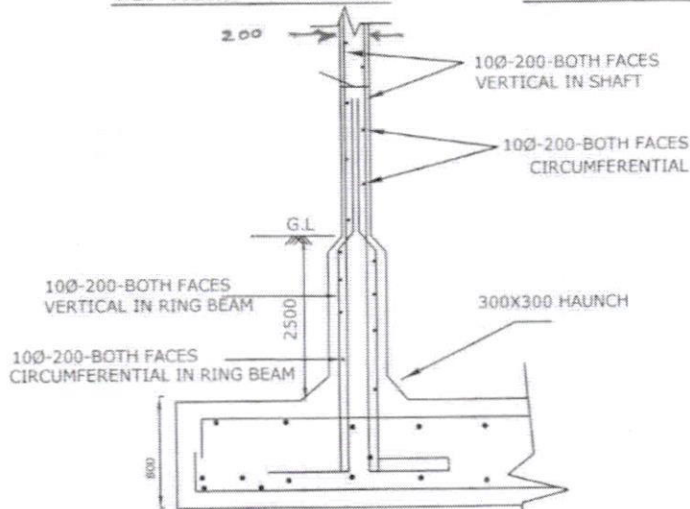

NOTE:

1. GRADE OF CONCRETE : M30
2. GRADE OF STEEL : Fe415
3. BASIC WIND SPEED : 150 KMPH
4. S.B.C. OF SOIL : 5.0 t/m²
5. DEPTH OF FOUNDATION : 2.5m BELOW GL UPTO TOP OF RAFT
6. FOR DETAILING OF REINFORCEMENT IS SP-34 SHALL BE FOLLOWED
7. PROVISIONS GIVEN IN IS 456-2000, IS 3370(PART-IV) SHALL BE FOLLOWED

//Approved//

[Signature]
Asst Executive Engineer


DETAIL 'P'
Dy. Executive Engineer


Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.

SCHEME:


90KL- OHBR-30M STG

DRG NO.3

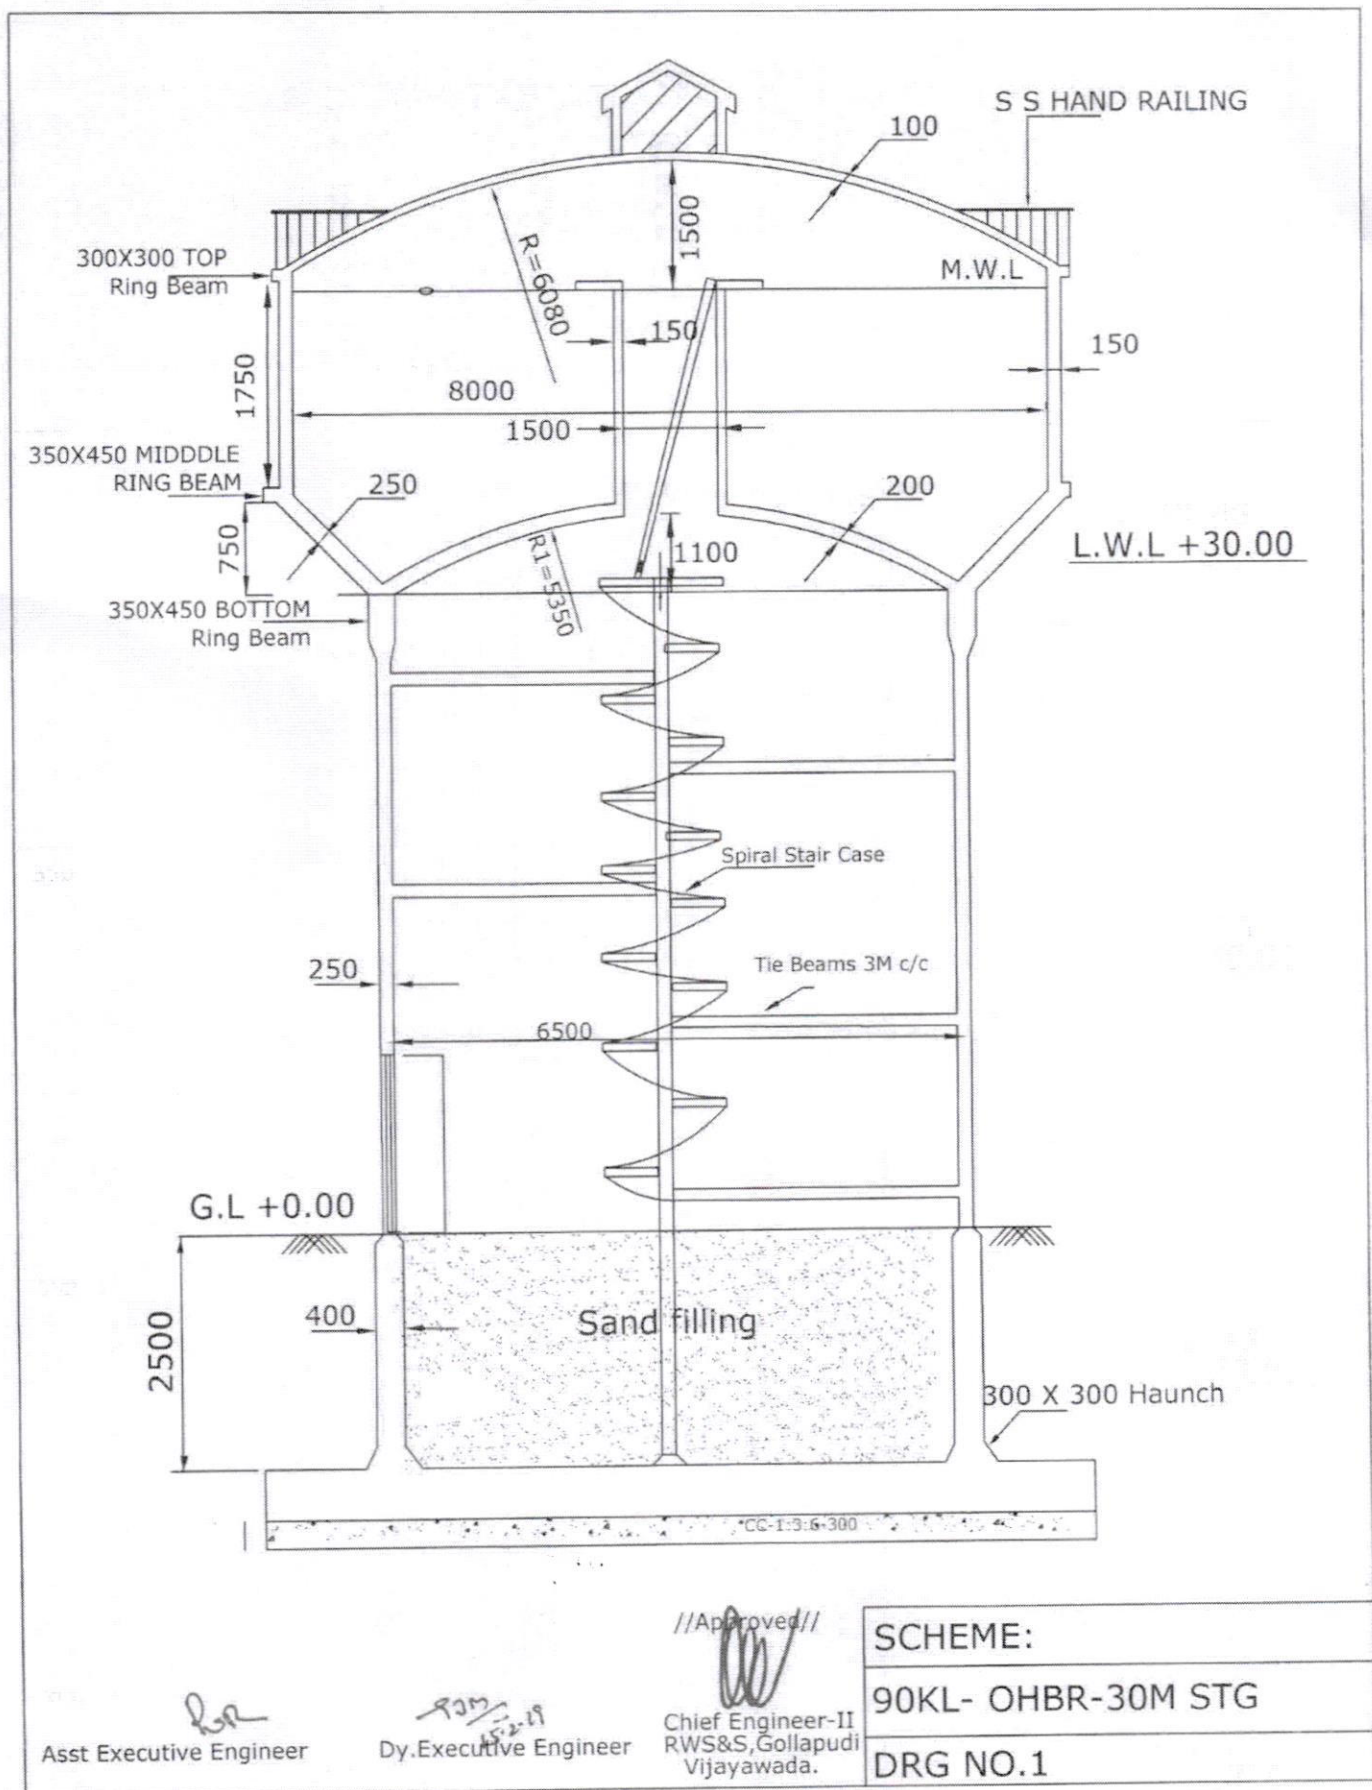

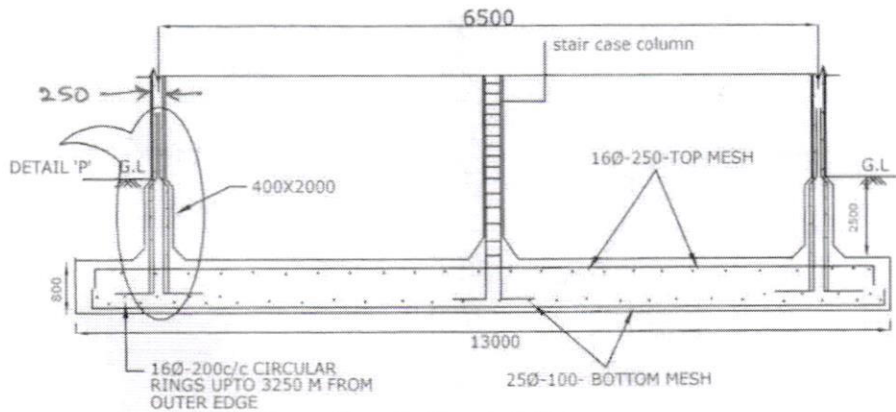


SECTIONAL ELEVATION OF RAFT

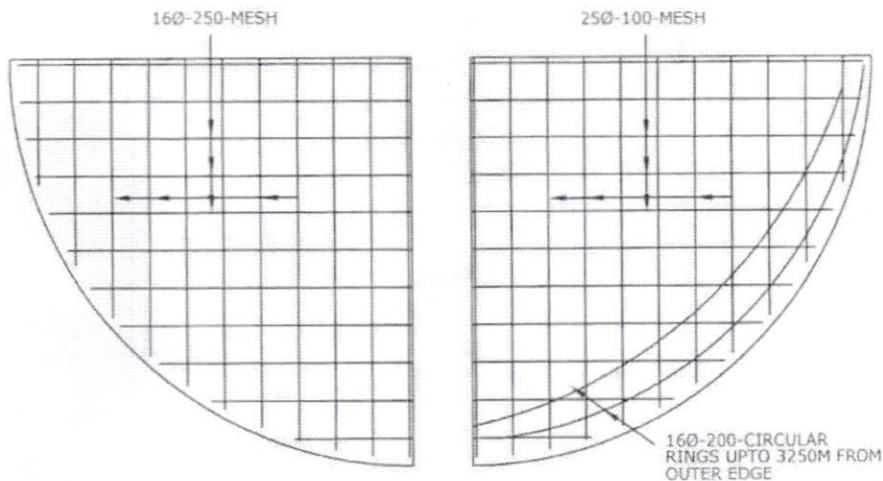

TOP REINFORCEMENT

BOTTOM REINFORCEMENT

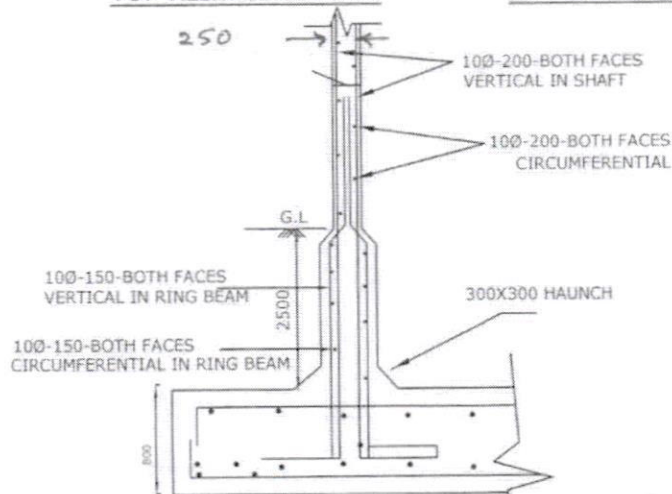

- NOTE:**
- 1.GRADE OF CONCRETE : M30
 - 2.GRADE OF STEEL : Fe415
 3. BASIC WIND SPEED : 200 KMPH
 - 4.S.B.C.OF SOIL : 10.0 t/m²
 - 5.DEPTH OF FOUNDATION : 2.5m BELOW GL UPTO TOP OF RAFT
 6. FOR DETAILING OF REINFORCEMENT IS SP-34 SHALL BE FOLLOWED
 7. PROVISIONS GIVEN IN IS 456-2000, IS 3370(PART-IV) SHALL BE FOLLOWED

POR
Asst Executive Engineer


DETAIL 'P'
Dy.Executive Engineer

//Approved//
Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.


SCHEME:

90KL- OHBR-30M STG

DRG NO.3

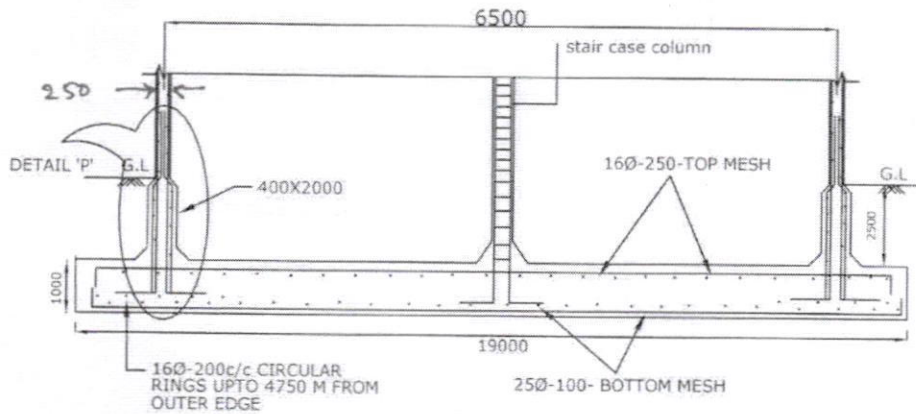


SECTIONAL ELEVATION OF RAFT

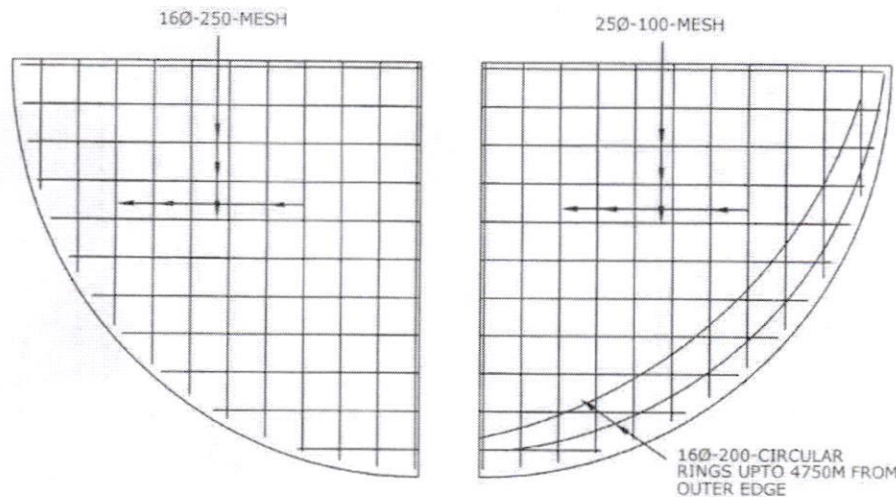

TOP REINFORCEMENT

BOTTOM REINFORCEMENT

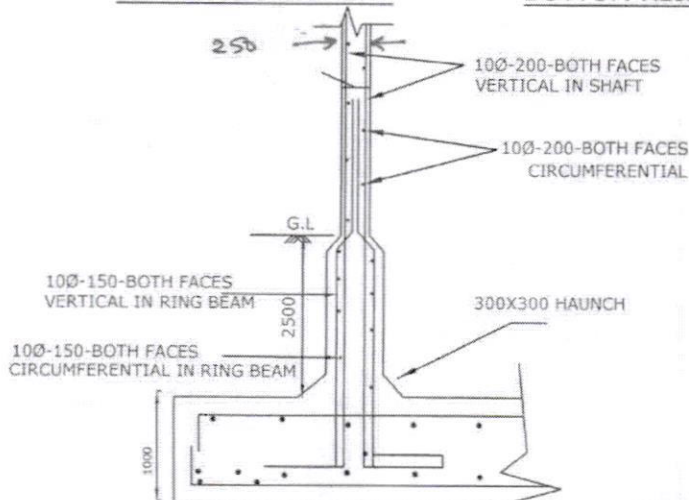

- NOTE:**
- 1.GRADE OF CONCRETE : M30
 - 2.GRADE OF STEEL : Fe415
 3. BASIC WIND SPEED : 200 KMPH
 - 4.S.B.C.OF SOIL : 5.0 t/m²
 - 5.DEPTH OF FOUNDATION : 2.5m BELOW GL UPTO TOP OF RAFT
 6. FOR DETAILING OF REINFORCEMENT IS SP-34 SHALL BE FOLLOWED
 7. PROVISIONS GIVEN IN IS 456-2000, IS 3370(PART-IV) SHALL BE FOLLOWED

//Approved//

R.R.
Asst Executive Engineer

DETAIL 'P'
Dy.Executive Engineer

Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.

SCHEME:

90KL- OHBR-30M STG

DRG NO.3