




150 KL SUMP

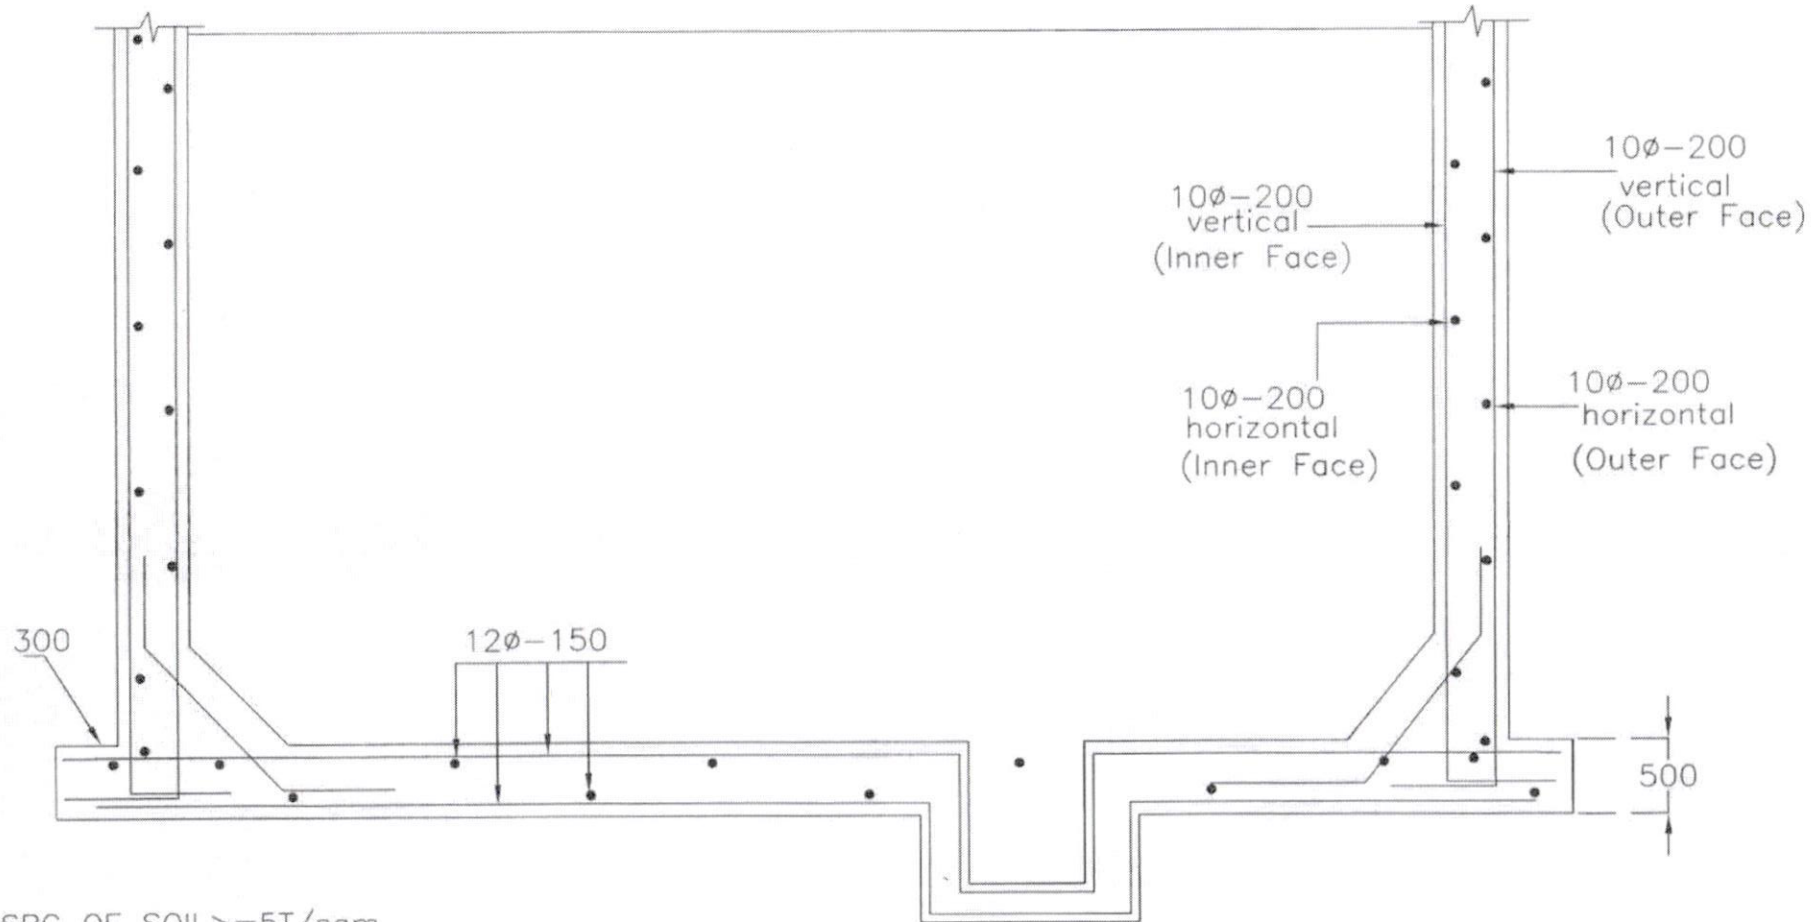

SBC OF SOIL $\geq 5T/sqm$

Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table $< 1.0m$ below GL

RGR
Asst Executive Engineer


RSM
Dy. Executive Engineer

// Approved //
Chief Engineer-II
RWS, Gollapudi
Vijayawada.

SCHEME:

DWG.NO.2

150 KL SUMP

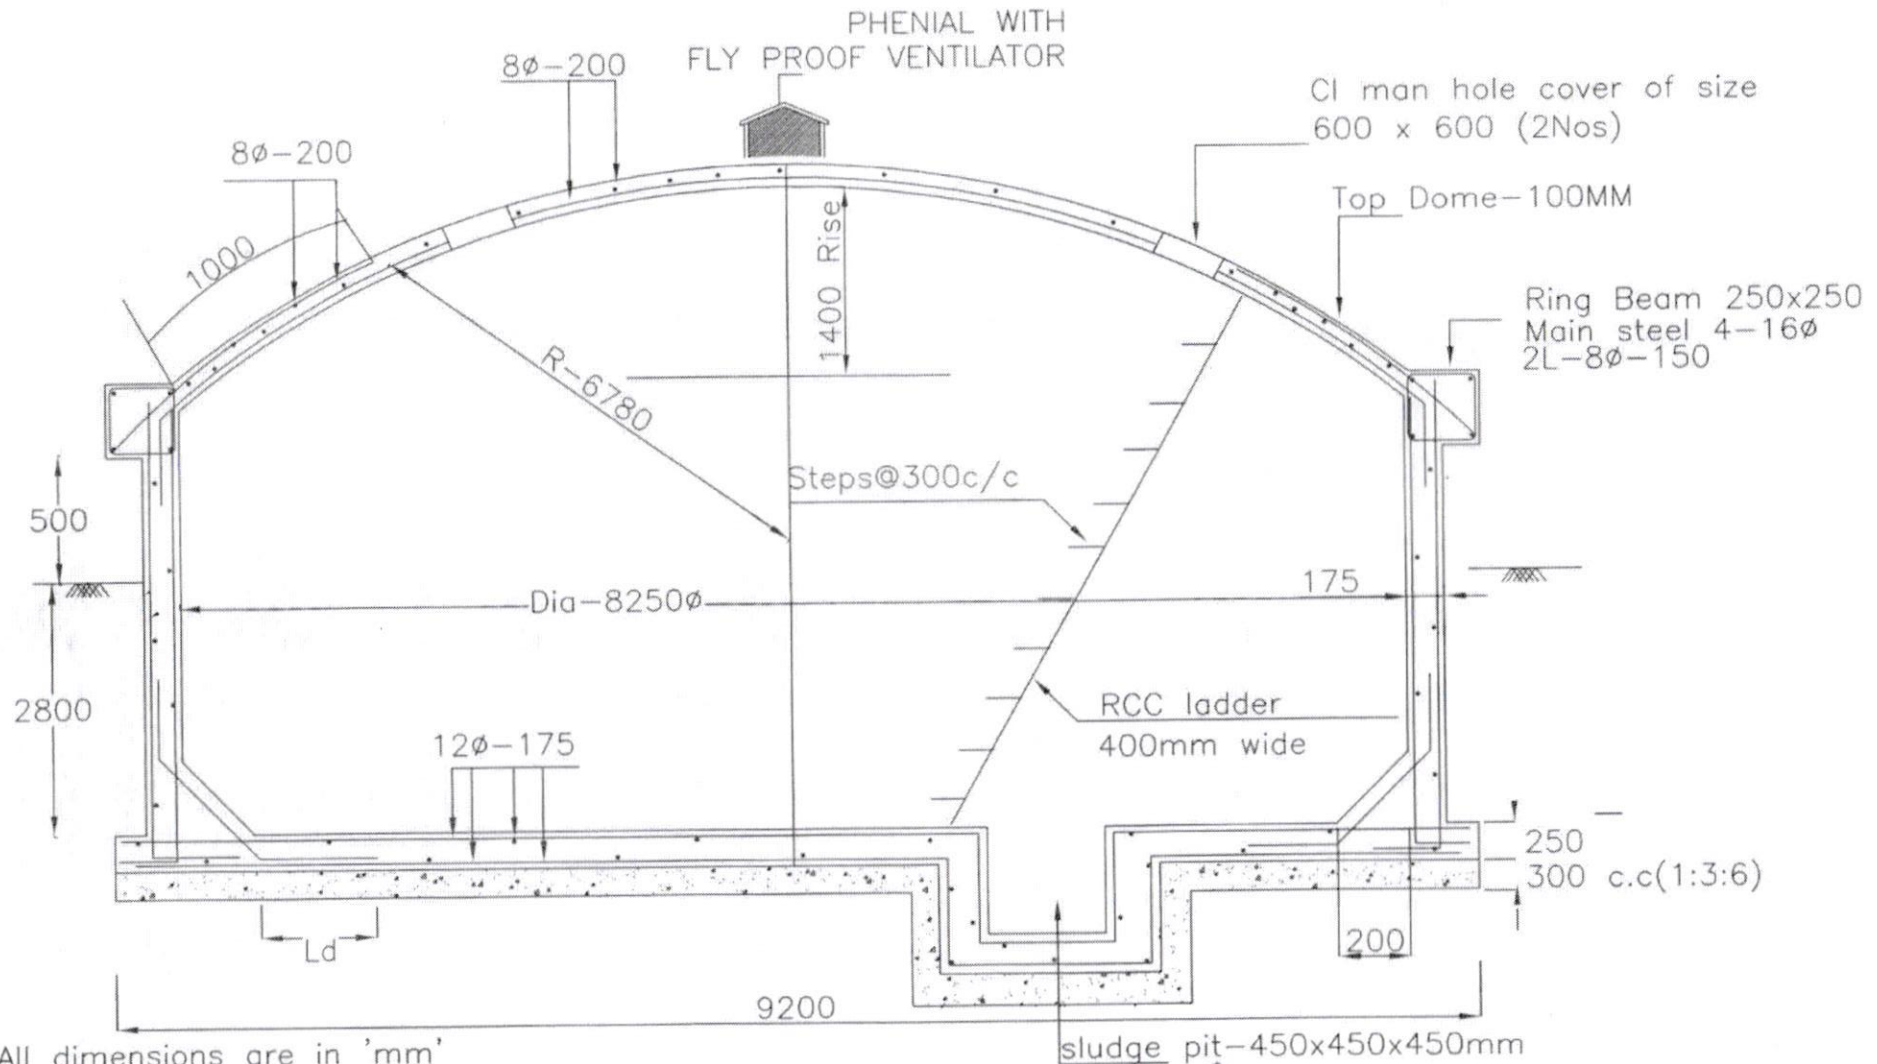

All dimensions are in 'mm'
Concrete mix V.R.C.C M30
Steel Fe-415
Reinforcement Details shall be as per IS - SP34

Asst Executive Engineer


Dy.Executive Engineer

Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.

SCHEME:

DWG.NO.1

150 KL SUMP

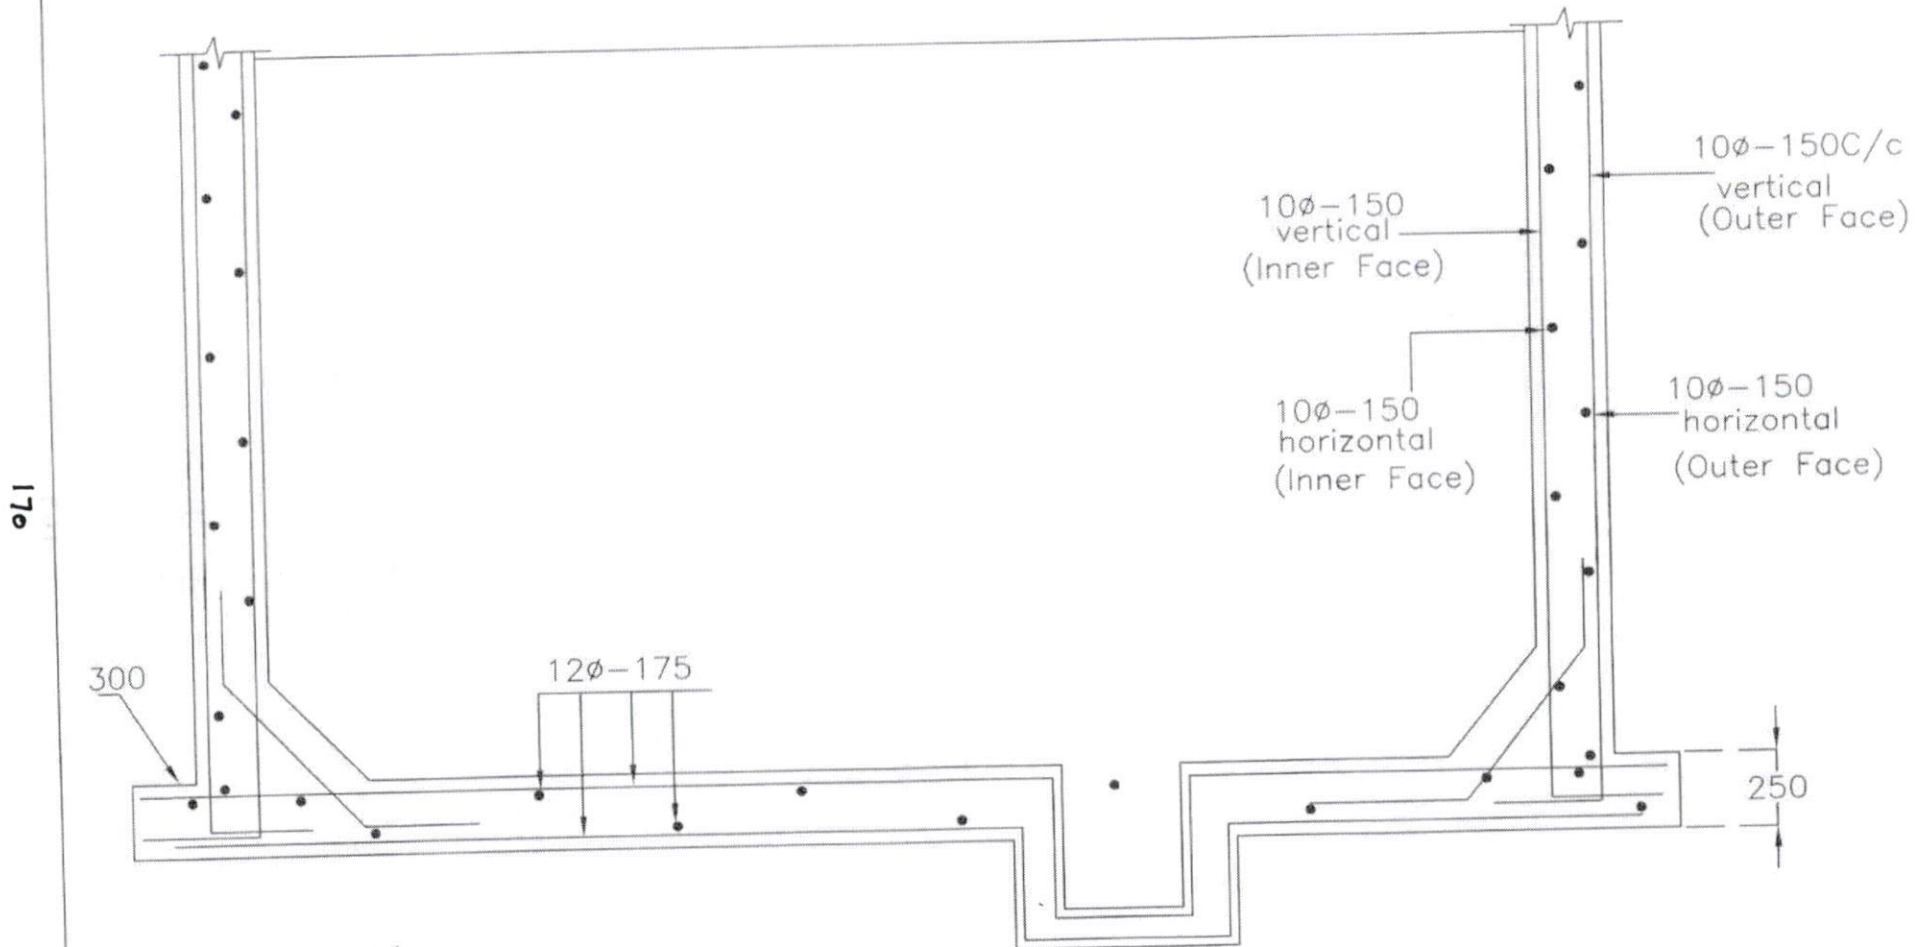

SBC OF SOIL $\geq 5T/sqm$

Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table $< 1.75m$ below GL

Asst Executive Engineer

Dy. Executive Engineer

Approved
Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.

SCHEME:

DWG.NO.2