


# 175 KL SUMP

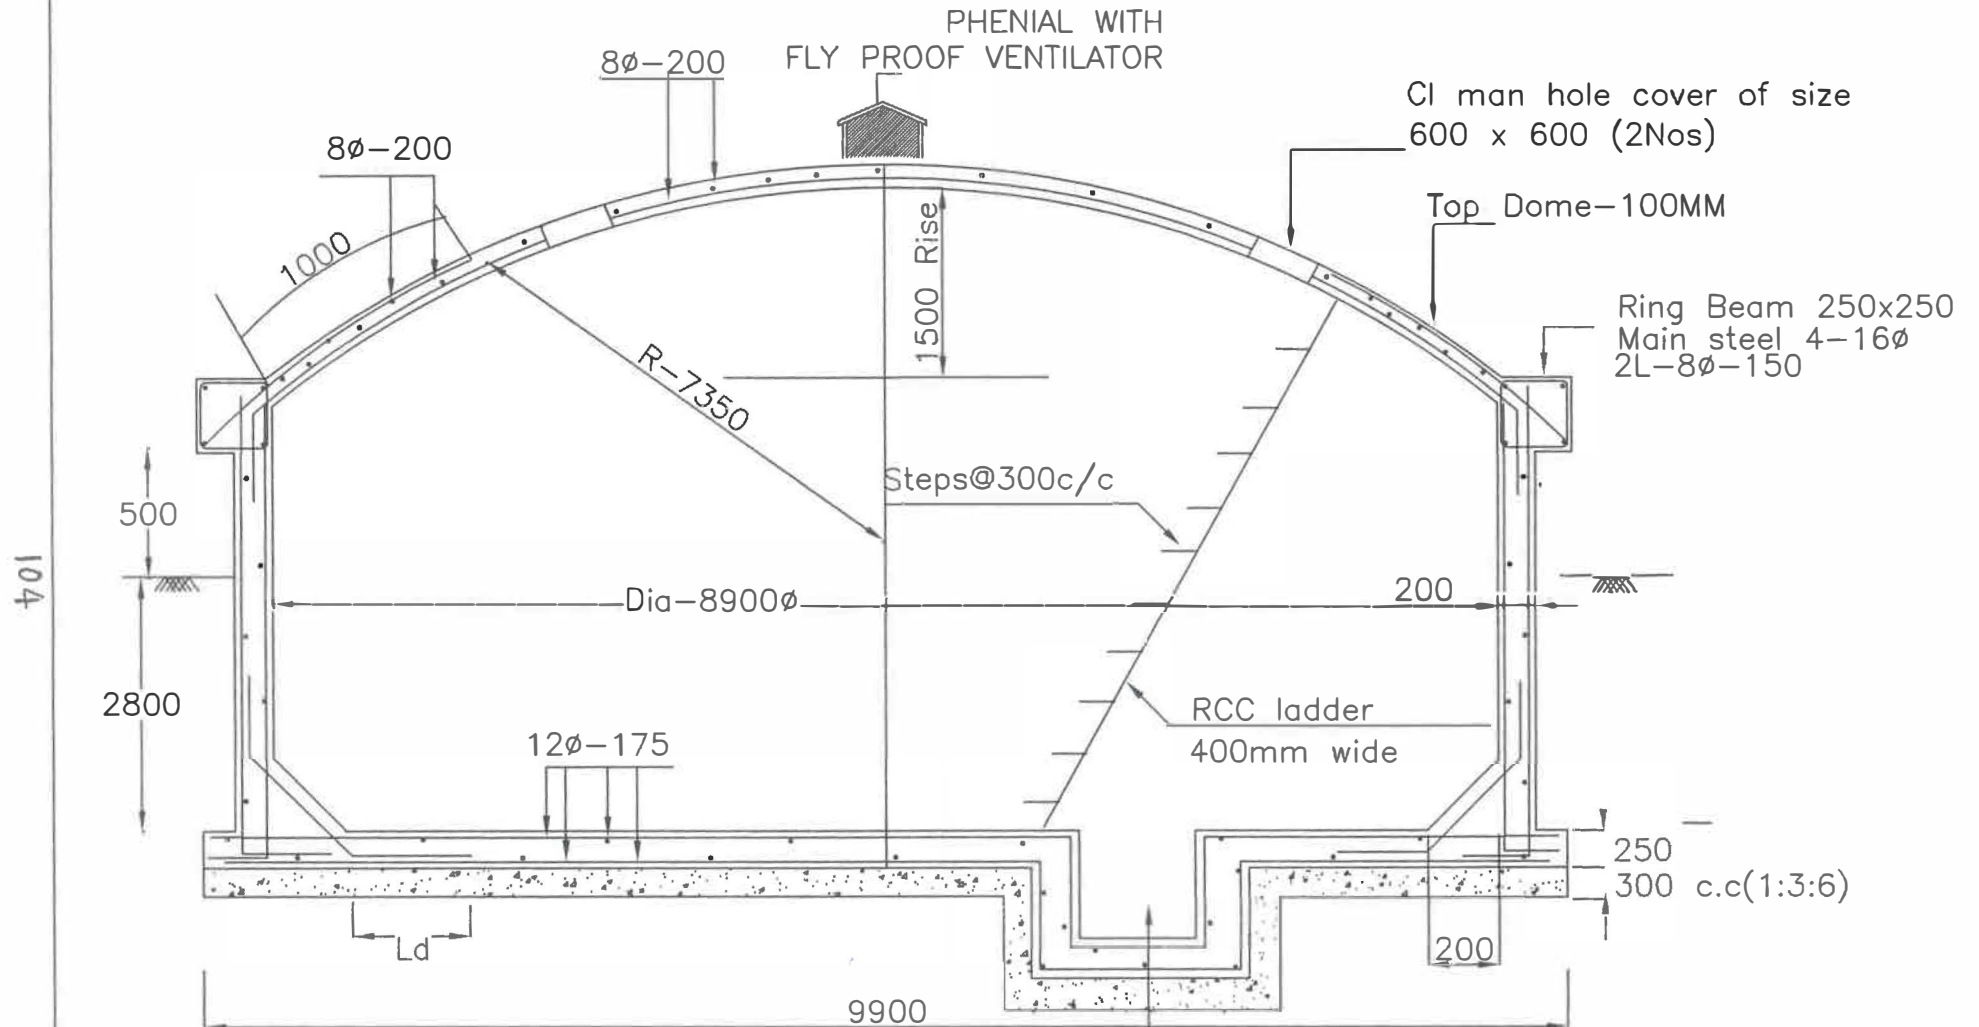

All dimensions are in 'mm'  
Concrete mix V.R.C.C M30  
Steel Fe-415  
Reinforcement Details shall be as per IS - SP34

H.P. Sankar  
Asst Executive Engineer

P.R.  
Dy.Executive Engineer


Y.S.  
Executive Engineer

//Approved//  
Chief Engineer  
RWS&S, Gollapudi  
Vijayawada.

SCHEME:

DWG.NO.1

# 175 KL SUMP

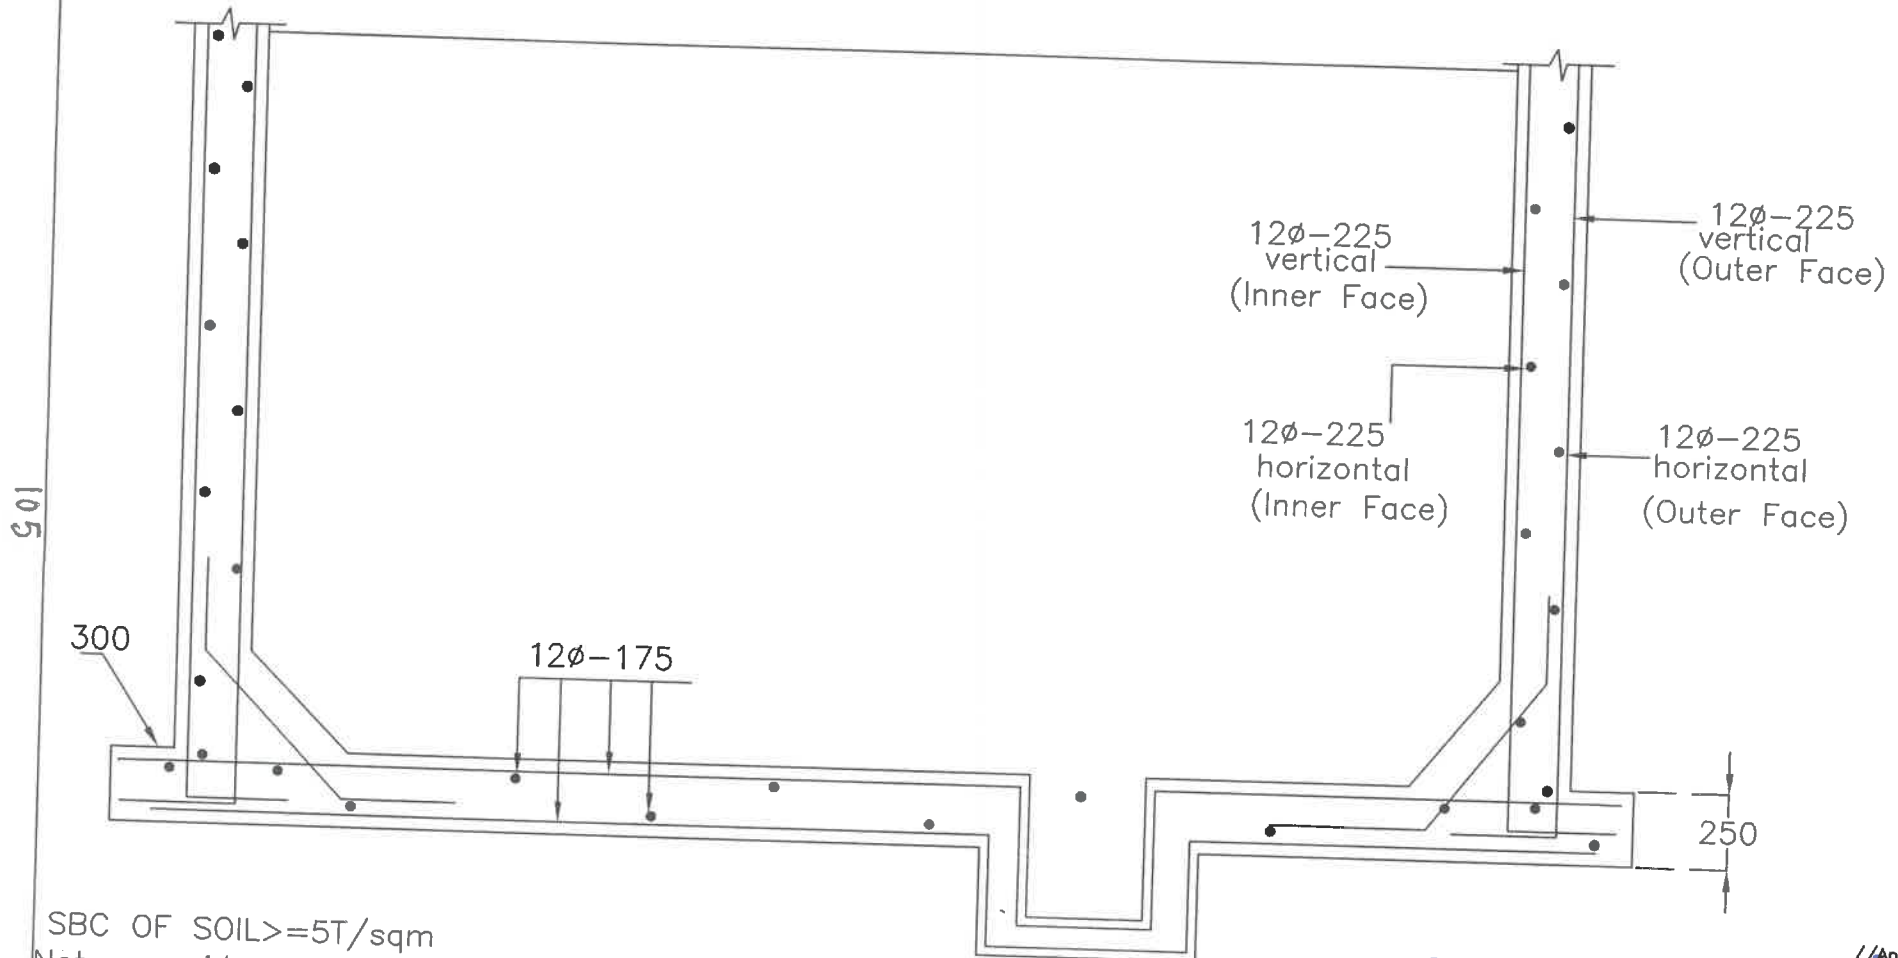

SBC OF SOIL  $\geq 5T/sqm$

Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table  $< 1.75m$  below GL

H. P. Sailaja  
Asst Executive Engineer

P. R.  
Dy. Executive Engineer


Y. S.  
Executive Engineer

// Approved //  
P. T. S.  
Chief Engineer-II  
RWS&S, Gollapudi  
Vijayawada.

SCHEME:

DWG.NO.2

# 175 KL SUMP

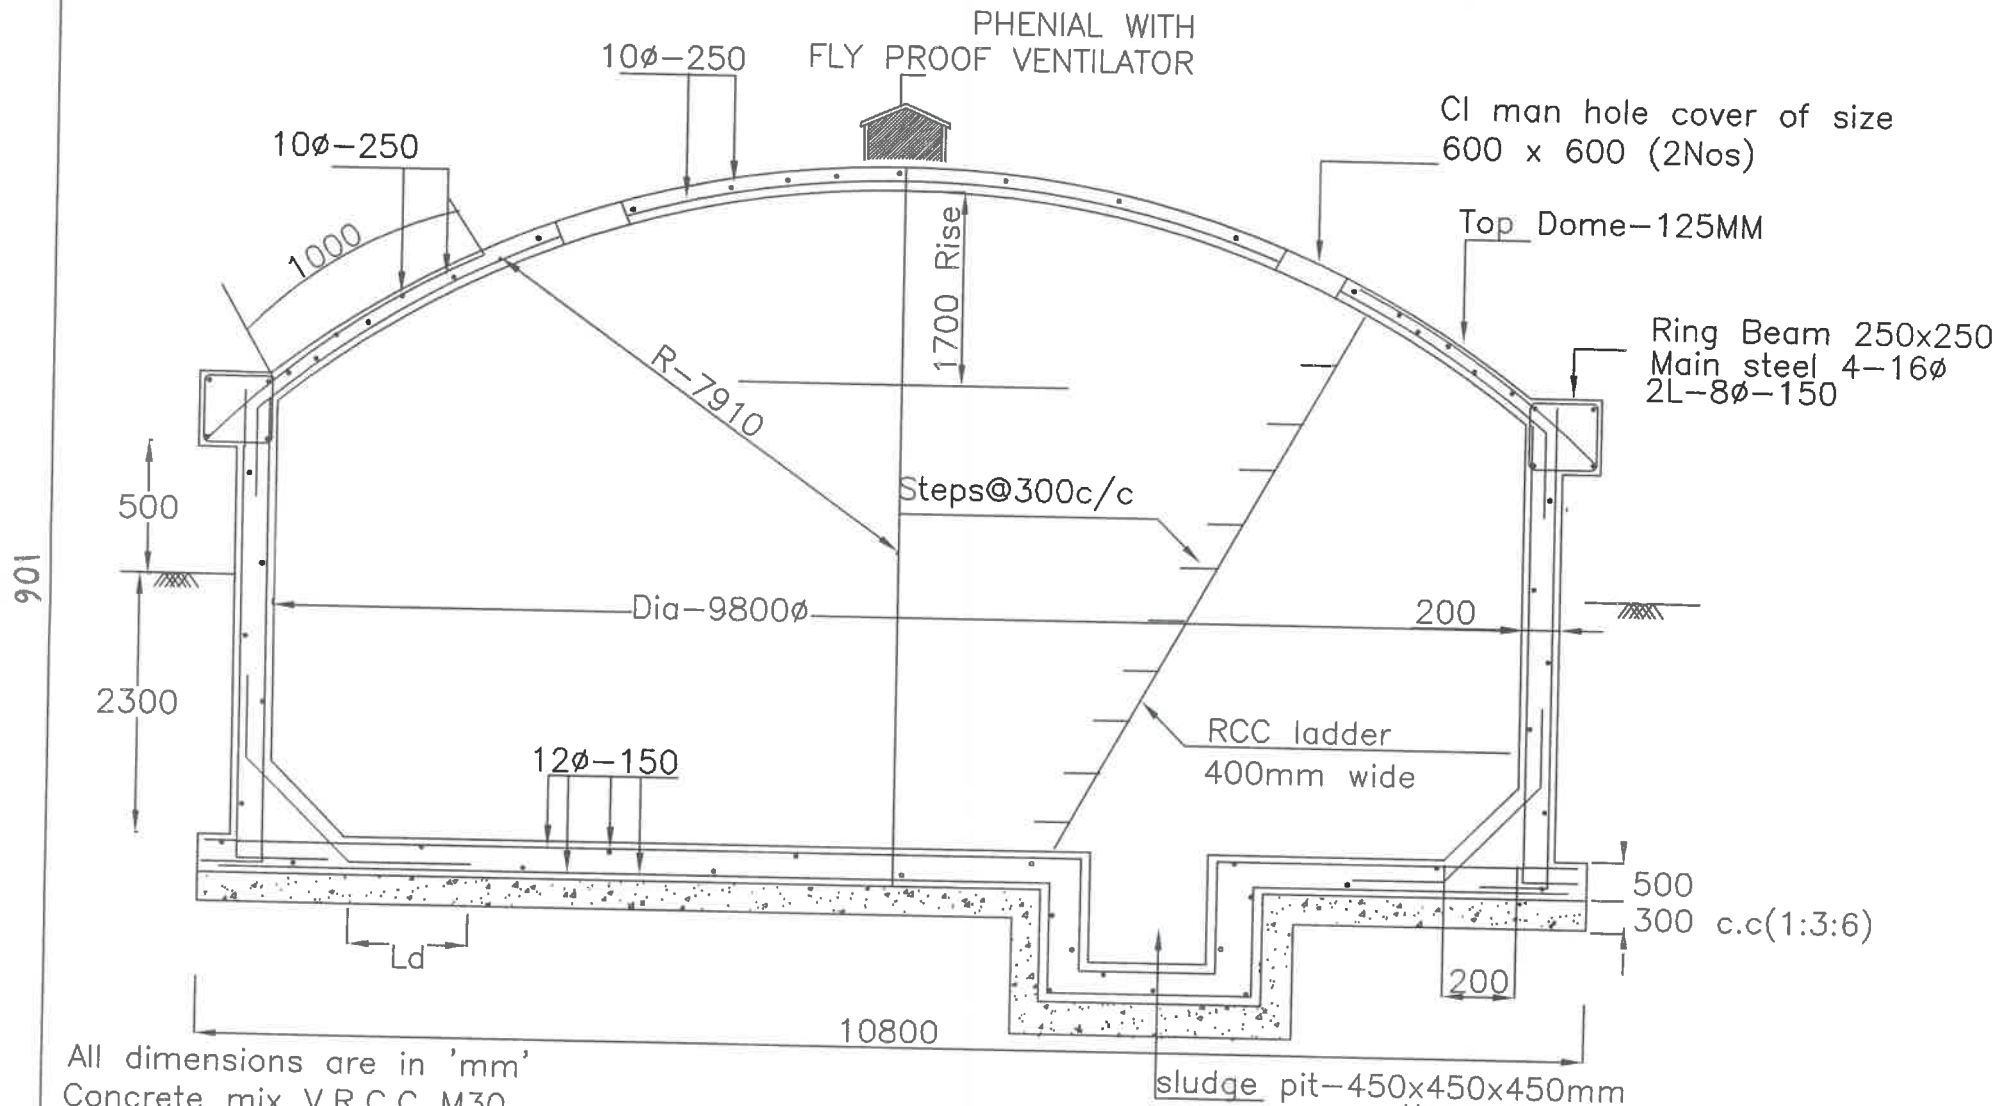

All dimensions are in 'mm'  
Concrete mix V.R.C.C M30  
Steel Fe-415  
Reinforcement Details shall be as per IS - SP34

H. L. Sailaja Pk  
Asst Executive Engineer Dy.Executive Engineer

Y.S  
Executive Engineer


Chief Engineer-II  
RWS&S, Gollapudi  
Vijayawada.

Sump is designed for uplift

SCHEME:

DWG.NO.1

# 175 KL SUMP

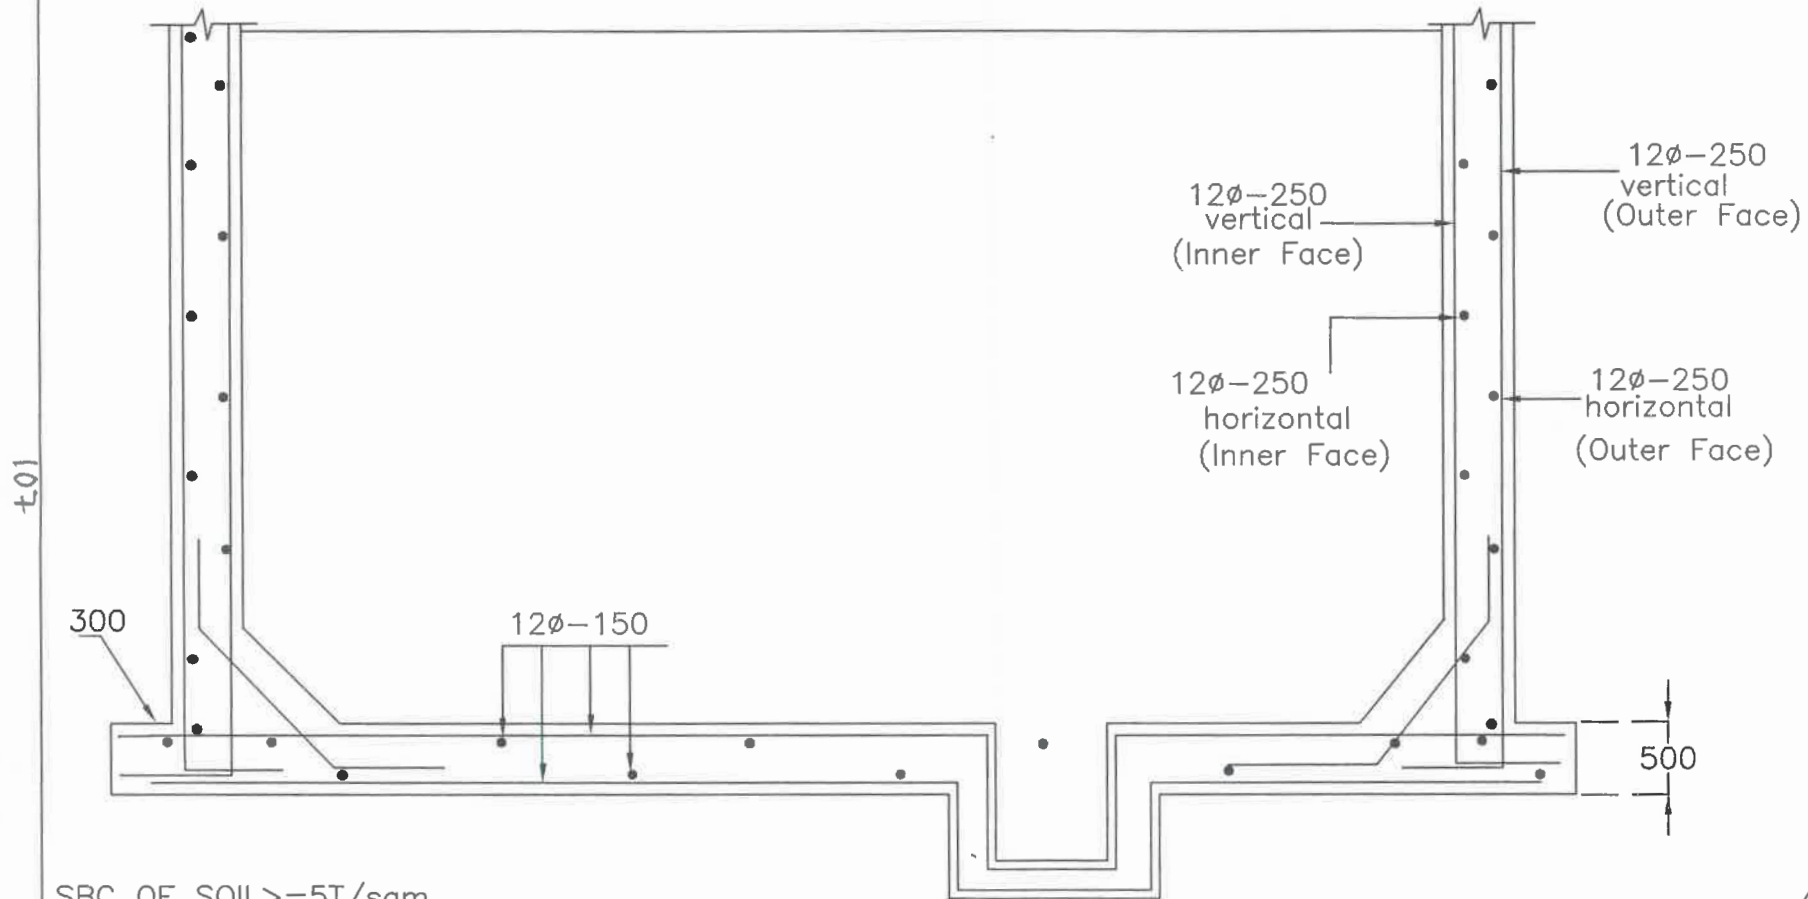

SBC OF SOIL  $\geq 5T/sqm$

Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table  $< 1.0m$  below GL

H. P. Saibajie  
Asst Executive Engineer

P.R.  
Dy. Executive Engineer

Y.S.  
Executive Engineer

// Approved //  
R.S.  
Chief Engineer - II  
RWS&S, Gollapudi  
Vijayawada.

SCHEME:

DWG.NO.2