


70 KL SUMP

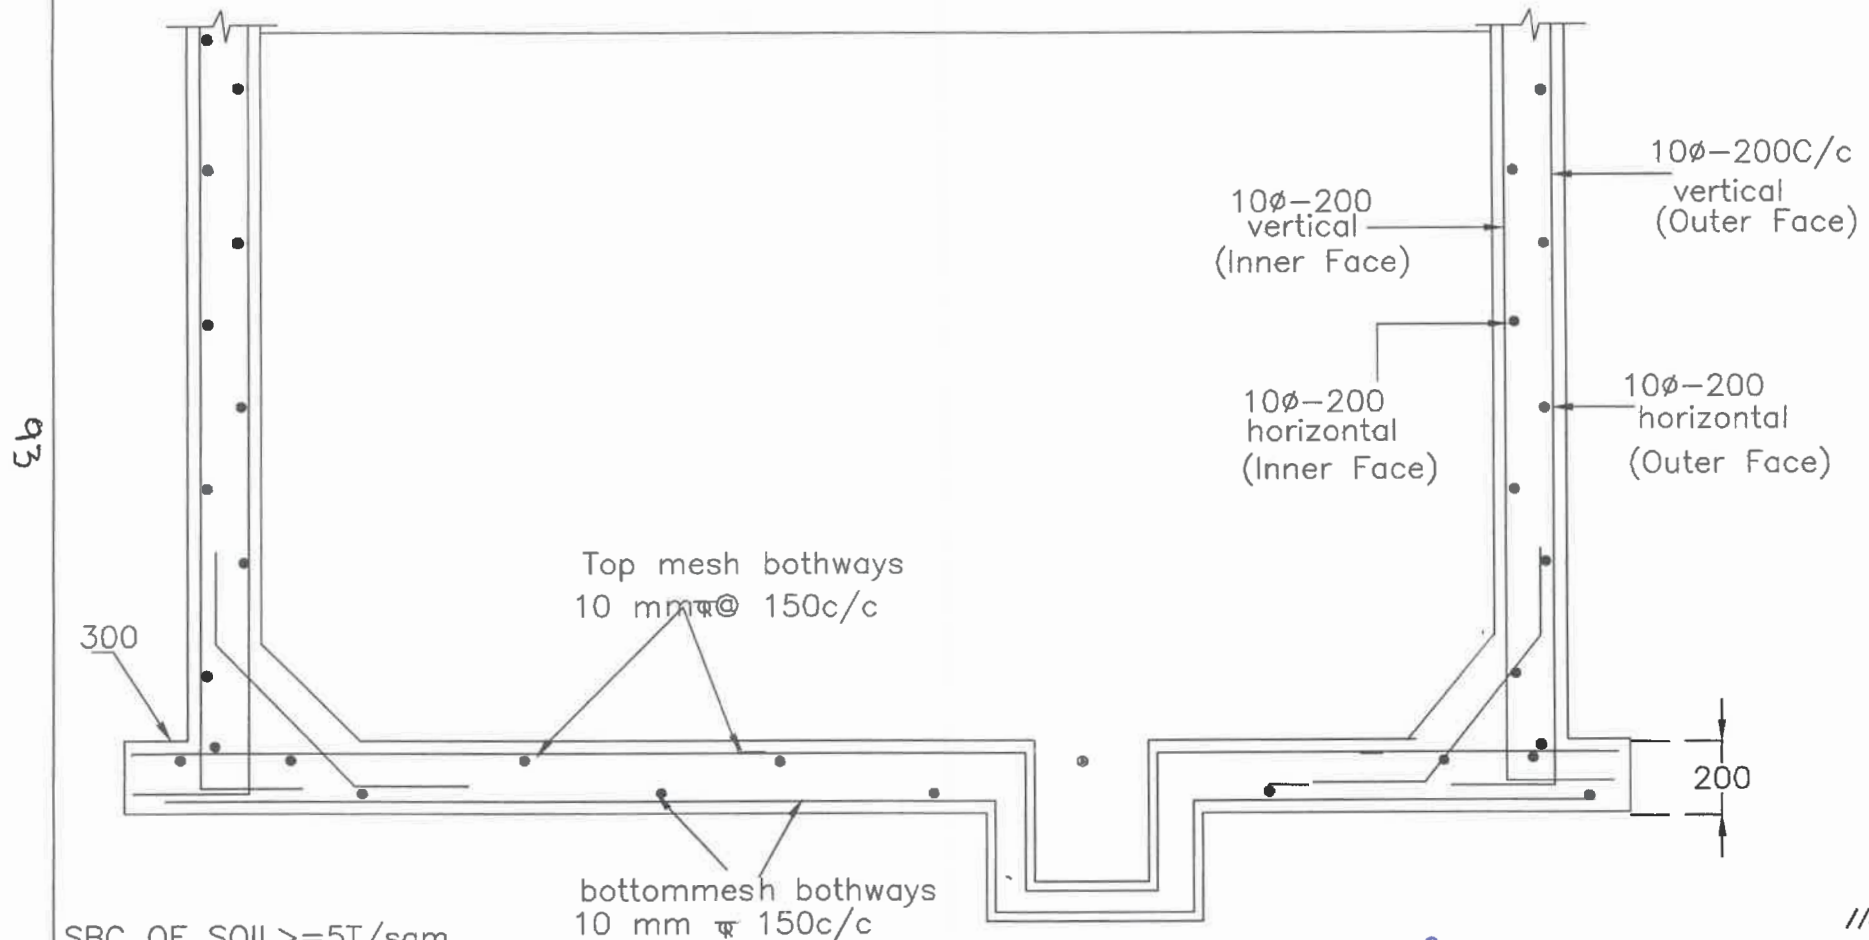

SBC OF SOIL $\geq 5T/sqm$

Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table $< 1.5m$ below GL

H.T. Sailesh
Asst Executive Engineer

DR
Dy. Executive Engineer


YS
Executive Engineer

//Approved//
RWS
Chief Engineer
RWS&S, Gollapudi
Vijayawada.

SCHEME:

DWG.NO.2

70 KL SUMP

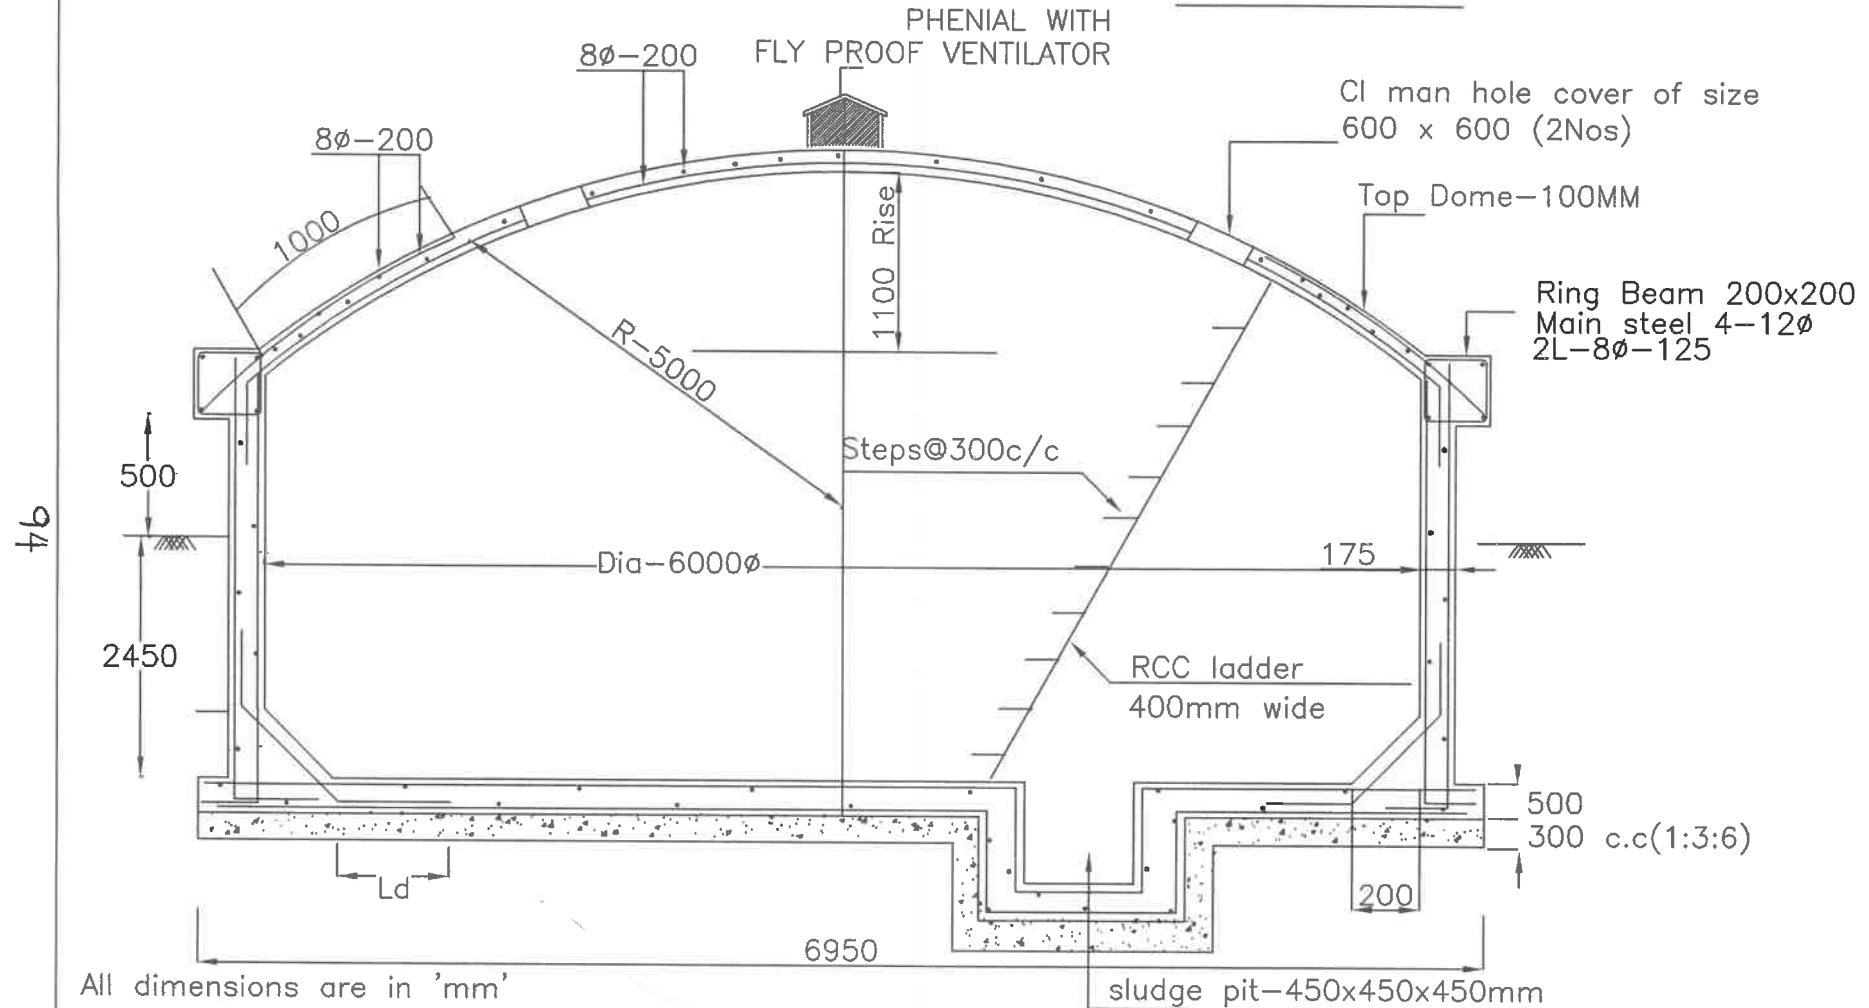

All dimensions are in 'mm'
Concrete mix V.R.C.C M30
Steel Fe-415
Reinforcement Details shall be as per IS - SP34

H.T. Sailaja
Asst Executive Engineer

POR
Dy. Executive Engineer

Y.S.
Executive Engineer


//Approved//
Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.

Sump is designed for uplift

SCHEME:

DWG.NO.1

70 KL SUMP

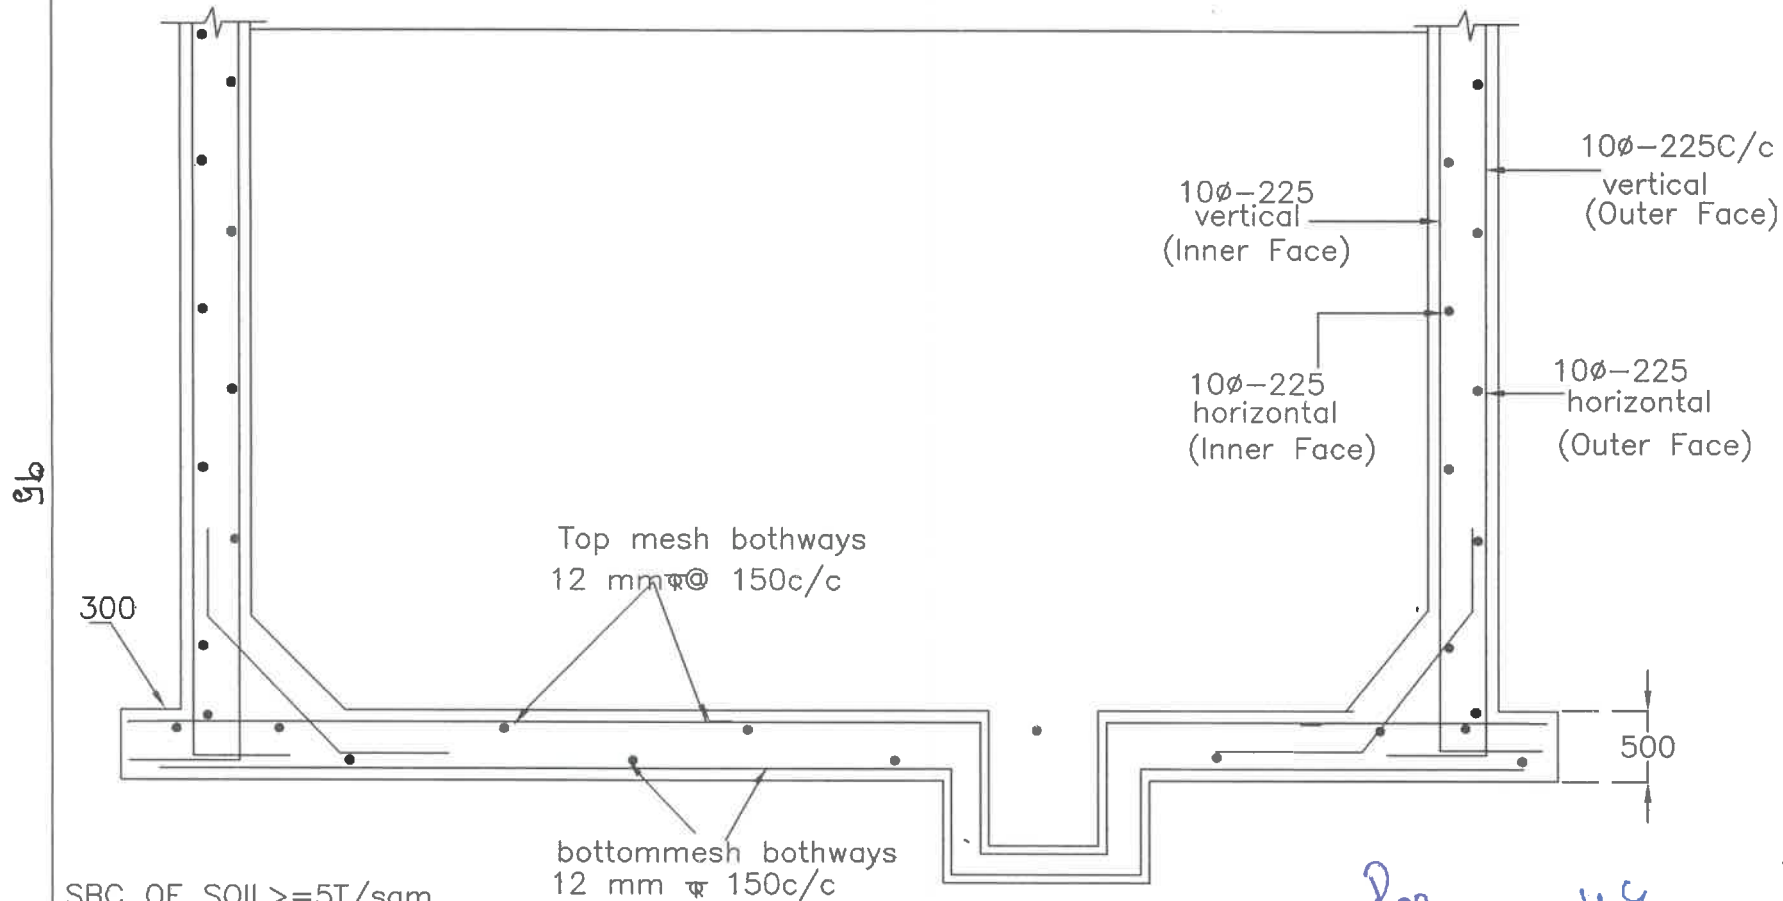

SBC OF SOIL $\geq 5T/sqm$

Note: provide sand bed as per site conditions and verify the uplift condition before grounding the work, if depth of water table $< 0.90m$ below GL

H. P. Sailaje
Asst Executive Engineer

R. R.
Dy. Executive Engineer

Y. S.
Executive Engineer

// Approved //
R. S. L.
Chief Engineer-II
RWS&S, Gollapudi
Vijayawada.

SCHEME:

DWG.NO.2